


## INBACMBM\*\*\*0000 Modbus to BACnet Server gateway

### Order Codes:

- INBACMBM1000000 (100 points)
- INBACMBM2500000 (250 points)
- INBACMBM6000000 (600 points)
- INBACMBM1K20000 (1200 points)
- INBACMBM3K00000 (3000 points)

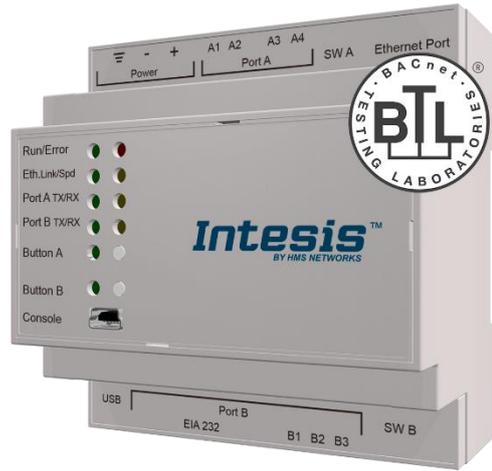

### HOW IT WORKS

The Intesis **INBACMBM\*\*\*0000** Gateway has been specially designed to work as a translator between Modbus Slave devices and BACnet IP or BACnet MSTP based control and monitoring systems.

Intesis acts as a master in the Modbus side, allowing both BACnet IP and BACnet MSTP client/master devices to read and write on all configured Modbus signals.

BACnet MSTP devices are connected to one of the serial ports of the gateway, while BACnet IP devices are connected to the Ethernet port. On the Modbus side, Modbus TCP devices are connected through the Ethernet port, while Modbus RTU devices can be connected to the serial ports of the gateway.


Configuration project is done through Intesis MAPS.




### FEATURES

- Manages Modbus TCP and Modbus RTU simultaneously
- Support for BACnet IP or BACnet MSTP, not simultaneously
- Supports up to two independent Modbus RTU channels (2x32 RTU devices per RS485), if BACnet MSTP protocol is not used.
- Modbus device templates available for easier integration
  - *Calendars*
  - *Schedules*
  - *Trend Logs*
- BACnet advanced features available:
  - Configuration through IP or USB (Console) port
  - Datalogging through external USB port
  - Front cover LED indicators to provide easy to check communication status on both the Ethernet and serial ports
- Includes Intesis MAPS with automatic updates for both Intesis MAPS and Gateway's firmware

### INTEGRATION EXAMPLE

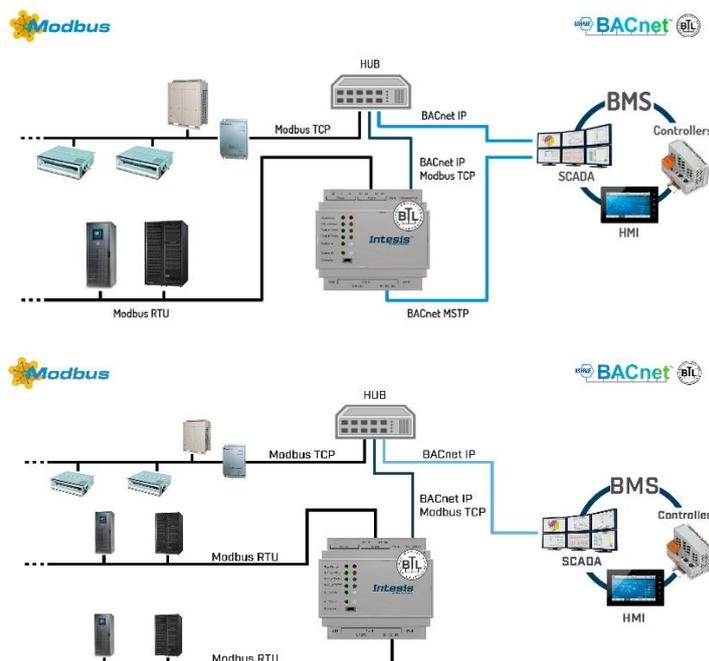

## CONNECTIONS

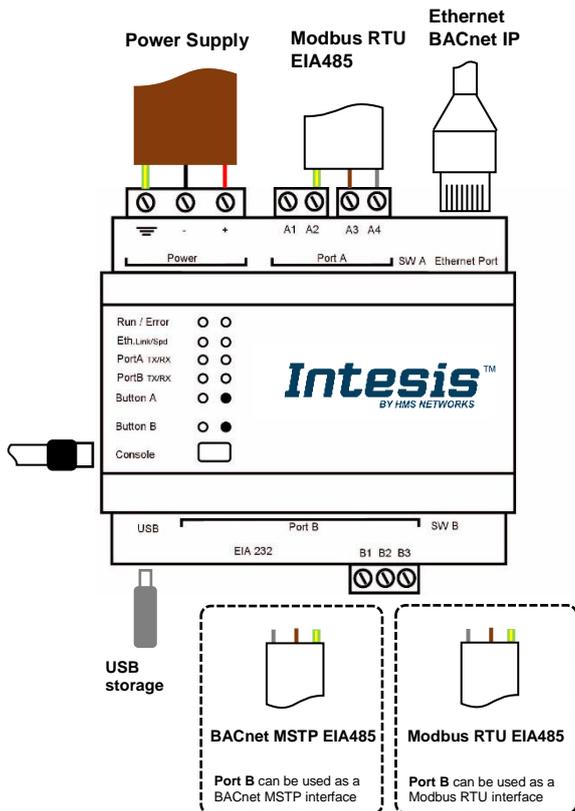

## PROTOCOLS



Modbus Protocol is a de facto standard, truly open and the most widely used network protocol in the industrial manufacturing environment. Modbus is used in multiple applications to monitor and program devices; to communicate between intelligent devices and sensors and instruments; to monitor field devices using PCs and HMIs.

But Modbus is not only an industrial protocol. Building, infrastructure, transportation and energy applications also make use of its benefits.

For further information visit [www.modbus.org](http://www.modbus.org)



BACnet is the Data Communication Protocol for Building Automation and Control Networks. Developed under the auspices of the American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE).

BACnet is an American national standard, a European standard, a national standard in more than 30 countries and an ISO global standard. The protocol is supported and maintained by ASHRAE Standing Standard Project committee 135.

For further information, please visit [www.bacnet.org](http://www.bacnet.org)

## COMMUNICATION

Connection	BACnet		Modbus	
	MSTP	IP	RTU	TCP
Connection	EIA485 (3 wire isolated)	10BASE-T 100BASE-TX	EIA485 (3 wire isolated) EIA232 (DB9 connector)	10BASE-T 100BASE-TX
Date rate	9.6, 19.2, 38.4, 57.6, 76.8, 115.2kbps	10 Mbps 100 Mbps	2.4, 4.8, 9.6, 19.2, 38.4, 57.6, 115.2kbps	10 Mbps 100 Mbps
Data Types & Functions supported	<b>Object types</b> 0-AO (Analog Output) 1-AI (Analog Input) 2-AV (Analog Value) 3-BO (Binary Output) 4-BI (Binary Input) 5-BV (Binary Value) 13-MI (Multistate Input) 14-MO (Multistate Output) 15-MV (Multistate Value)	<b>Functions</b> Trend Logs Calendars Schedules	1-Read Digital Outputs 2-Read Digital Inputs 3-Read Holding Registers 4-Read Analog Registers 5-Write Single Digital Output 6-Write Single Analog Register 15-Write Multiple Digital Output 16-Write Multiple Holding Registers	

## ELECTRICAL & MECHANICAL FEATURES

<b>Enclosure</b>	Plastic, type PC (UL 94 V-0) Net dimensions (dxwxh): 90x88x56 mm Recommended space for installation (dxwxh): 130x100x100mm Color: Light Grey, RAL 7035	<b>Battery</b>	Size: Coin 20mm x 3.2mm Capacity: 3V / 225mAh Type: Manganese Dioxide Lithium
<b>Mounting</b>	Wall. DIN rail EN60715 TH35.	<b>Console Port</b>	Mini Type-B USB 2.0 compliant 1500VDC isolation
<b>Terminal Wiring</b> (for power supply and low-voltage signals)	Per terminal: solid wires or stranded wires (twisted or with ferrule) 1 core: 0.5mm <sup>2</sup> ... 2.5mm <sup>2</sup> 2 cores: 0.5mm <sup>2</sup> ... 1.5mm <sup>2</sup> 3 cores: not permitted If cables are more than 3.05 meters long, Class 2 cable is required.	<b>USB port</b>	Type-A USB 2.0 compliant Only for USB flash storage device (USB pen drive) Power consumption limited to 150mA (HDD connection not allowed)
<b>Power</b>	1 x Plug-in screw terminal block (3 poles) 9 to 36VDC +/-10%, Max.: 140mA. 24VAC +/-10% 50-60Hz, Max.: 127mA Recommended: 24VDC	<b>Push Button</b>	Button A: Check the user manual Button B: Check the user manual
<b>Ethernet</b>	1 x Ethernet 10/100 Mbps RJ45 2 x Ethernet LED: port link and activity	<b>Operation Temperature</b>	0°C to +60°C
<b>Port A</b>	1 x Serial EIA485 Plug-in screw terminal block (2 poles) A, B 1 x Plug-in screw terminal block green (2 poles) SGND (Reference ground or shield) 1500VDC isolation from other ports	<b>Operational Humidity</b>	5 to 95%, no condensation
<b>Switch A (SWA)</b>	1 x DIP-Switch for serial EIA485 configuration: Position 1: ON: 120 Ω termination active Off: 120 Ω termination inactive Position 2-3: ON: Polarization active Off: Polarization inactive	<b>Protection</b>	IP20 (IEC60529)
<b>PORT B</b>	1 x Serial EIA232 (SUB-D9 male connector) Reserved for future use 1 x Serial EIA485 Plug-in screw terminal block (3 poles) A, B, SGND (Reference ground or shield) 1500VDC isolation from other ports (except PORT B: EIA232) : 240mA Voltage rating: 16VDC	<b>LED Indicators</b>	10 x Onboard LED indicators 2 x Run (Power)/Error 2 x Ethernet Link/Speed 2 x Port A TX/RX 2 x Port B TX/RX 1 x Button A indicator 1 x Button B indicator
<b>Switch B (SWB)</b>	1 x DIP-Switch for serial EIA485 configuration: Position 1: ON: 120 Ω termination active Off: 120 Ω termination inactive Position 2-3: ON: Polarization active Off: Polarization inactive		