

MAXinBOX 24 MAXinBOX 16 v3 MAXinBOX 8 v3

Multifunction Actuator with 24 / 16 / 8 Outputs

ZIO-MB24
ZIOMB16V3
ZIOMB8V3

Application program version: [1.5]
User manual edition: [1.5]_a

www.zennio.com

CONTENTS

Contents	2
Document Updates	3
1 Introduction	4
1.1 MAXinBOX 24 / MAXinBOX 16 v3 / MAXinBOX 8 v3.....	4
1.2 Installation.....	5
1.3 Start-Up and Power Loss.....	6
2 Configuration.....	7
2.1 General.....	7
2.2 Outputs.....	10
2.3 Logic Functions.....	11
2.4 Master light	12
2.5 Scene Temporisation.....	15
2.6 Manual Control	17
ANNEX I. Communication Objects.....	22

DOCUMENT UPDATES

Version	Changes	Page(s)
[1.5]_a	Changes in the application program: <ul style="list-style-type: none"> • 2 Master Light modules added. • Optimisation of the logic functions, shutters and Heartbeat modules. 	-
[1.4]_a	Changes in the application program: <ul style="list-style-type: none"> • Optimisation of the individual outputs, shutters, fan coil and logic functions modules. 	-
[1.2]_a	New devices: MAXinBOX 16 / 8 v3 Changes in the application program of MAXinBOX 24: <ul style="list-style-type: none"> • Optimisation of the individual outputs, shutters, fan coil and logic functions modules. 	-
[1.1]_a	Changes in the application program of MAXinBOX 24: <ul style="list-style-type: none"> • Parameters reorganization. 	-

1 INTRODUCTION

1.1 MAXINBOX 24 / MAXINBOX 16 V3 / MAXINBOX 8 V3

MAXinBOX 24, MAXinBOX 16 v3 and MAXinBOX 8 v3 from Zennio are two versatile KNX actuators featuring a wide variety of functions, being both of them entirely equivalent except for the number of relay outputs they offer (24, 16 and 8, respectively):

- **24 / 16 / 8 relay outputs**, respectively, configurable as:
 - Up to **24 / 16 / 8 individual ON/OFF outputs**,
 - Up to **12 / 8 / 4 independent shutter channels** (with or without slats),
 - Up to **6 / 4 / 2 two-pipe fan coil modules** where both the fan speed control and the valve control are performed through relays,
 - A combination of the above.
- **30 (MAXinBOX 24) / 20 (MAXinBOX 16 / 8 v3) customisable, multi-operation logic functions.**
- **2 Master light control modules** for an easy, out-of-the-box control of a set of luminaires (or functionally equivalent devices) one of which acts as a general lamp and the others as secondary lamps.
- **Scene-triggered action control**, with an optional delay in the execution.
- **Manual operation / supervision** of the 24 / 16 / 8 relay outputs through the on-board pushbuttons and LEDs.
- **Heartbeat** or periodical “still-alive” notification.
- **Relay Switches Counter.**

1.2 INSTALLATION

MAXinBOX connects to the KNX bus through the on-board KNX connector.

Once the device is provided with power from the KNX bus, both the individual address and the associated application programme may be downloaded.

This device does not need any additional external power since it is entirely powered through the KNX bus.

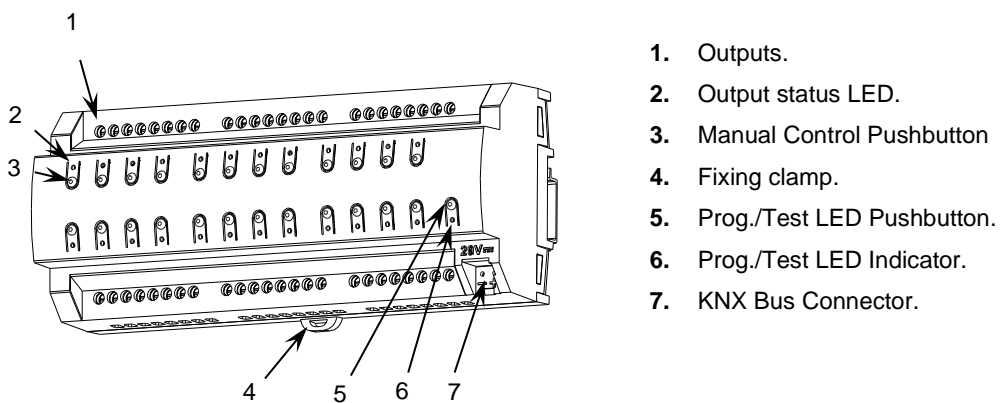


Figure 1. Element Diagram for MAXinBOX 24.

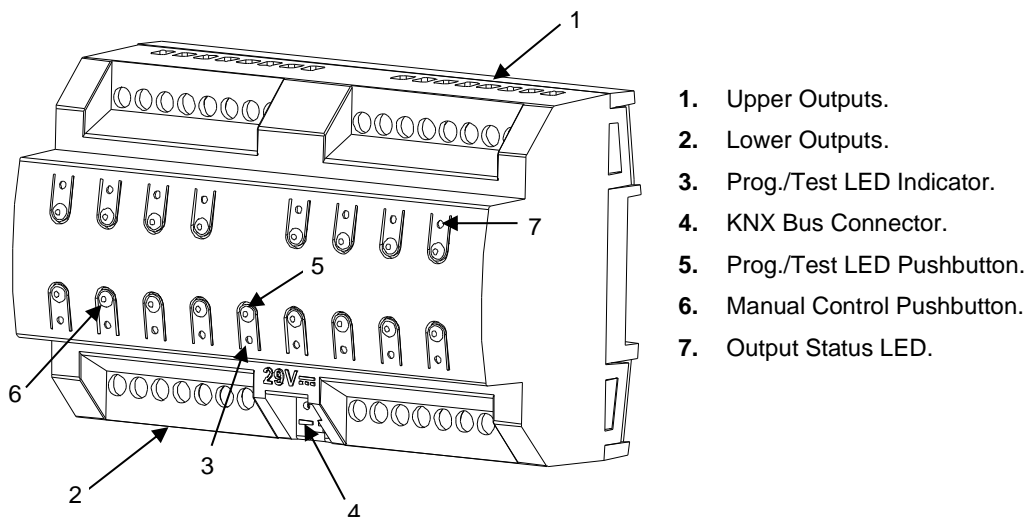


Figure 2. Element Diagram for MAXinBOX 16 v3

Note: *the above element diagram is slightly different for MAXinBOX 8 v3, although entirely analogous.*

The main elements of the device are described next.

- **Prog./Test Pushbutton:** a short press on this button sets the device into the programming mode, making the associated LED light in red.

Note: *if this button is held while plugging the device into the KNX bus, the device will enter into **safe mode**. In such case, the LED will blink in red every 0.5 seconds.*

- **Outputs:** output ports for the insertion of the stripped cables of the systems being controlled by the actuator (see section 2.2). Please secure the connection by means of the on-board screws.

To get detailed information about the technical features of this device, as well as on the installation and security procedures, please refer to the corresponding **Datasheet**, bundled with the original device packaging and also available at www.zennio.com.

1.3 START-UP AND POWER LOSS

During the start-up of the device, the Prog./Test LED will blink in blue colour for a few seconds before the device is ready. External orders will not be executed during this time, but afterwards.

Depending on the configuration, some specific actions will also be performed during the start-up. For example, the integrator can set whether the output channels should switch to a particular state and whether the device should send certain objects to the bus after the power recovery. Please consult the next sections of this document for further details.

On the other hand, when a bus power failure takes place, MAXinBOX will interrupt any pending actions, and will save its state so it can be recovered once the power supply is restored.

For safety reasons, all **shutter channels** will be stopped (i.e., the relays will open) if a power loss takes place, while the individual outputs and fan coil contacts will switch to the specific state configured in ETS (if any).

2 CONFIGURATION

2.1 GENERAL

After importing the corresponding database in ETS and adding the device into the topology of the desired project, the configuration process begins by entering the Parameters tab of the device.

ETS PARAMETERISATION

The only parameterisable screen available by default is General. From this screen it is possible to activate/deactivate all the required functionality.

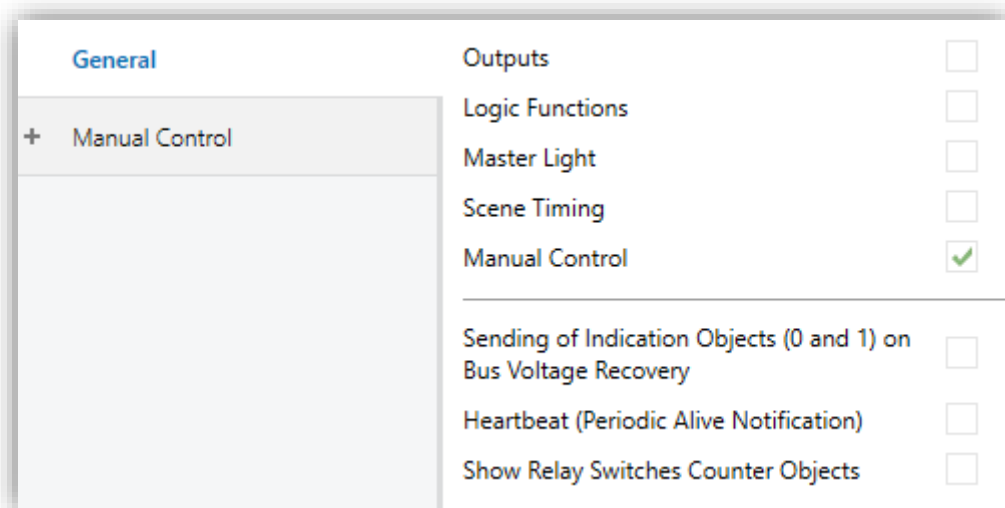


Figure 3. General screen

- **Outputs** [*disabled/enabled*]¹: enables o disables the “Outputs” tab on the left menu. See section 2.2 for more details.
- **Logic Functions** [*disabled/enabled*]: enables o disables the “Logic Functions” tab on the left menu. See section 2.3 for more details.

¹ The default values of each parameter will be highlighted in blue in this document, as follows: [*default/rest of options*].

- **Master Light** [*disabled/enabled*]: enables o disables the “Master Light” tab on the left menu. See section 2.4 for more details.
- **Scene Temporization** [*disabled/enabled*]: enables o disables the “Scene Temporization” tab on the left menu. See section 2.5 for more details.
- **Manual Control** [*disabled/enabled*]: enables o disables the “Manual Control” tab on the left menu. See section 2.6 for more details.
- **Sending of Indication Objects (0 and 1) on Bus Voltage Recovery** [*disabled/enabled*]: this parameter lets the integrator activate two new communication objects (“Reset 0” and “Reset 1”), which will be sent to the KNX bus with values “0” and “1” respectively whenever the device begins operation (for example, after a bus power failure). It is possible to parameterise a certain **delay** [*0...255*] to this sending.

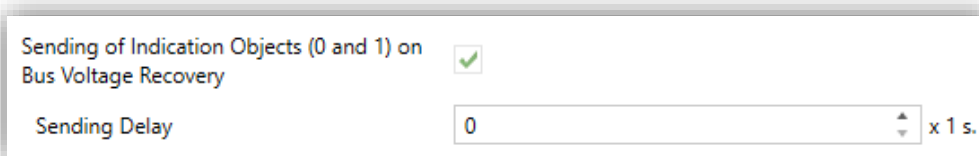


Figure 4. Sending of Indication objects on bus voltage recovery

- **Heartbeat (Periodic Alive Notification)** [*disabled/enabled*]: this parameter lets the integrator incorporate a one-bit object to the project (“**[Heartbeat Object to Send ‘1’]**”) that will be sent periodically with value “1” to notify that the device is still working (*still alive*).

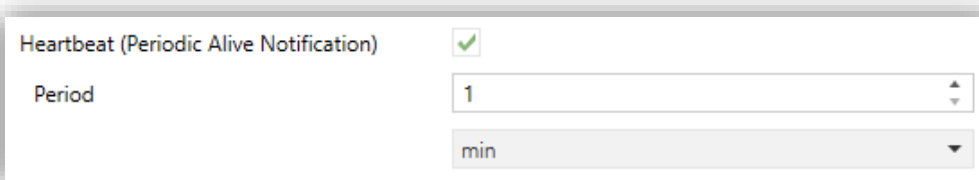


Figure 5. Heartbeat (Periodical Alive Notification).

Note: The first sending after download or bus failure takes place with a delay of up to 255 seconds, to prevent bus overload. The following sendings match the period set.

- **Show Relay Switches Counter Objects** [[disabled/enabled](#)]: enables two communication objects to keep track of the number of switches performed by each of the relays ("**[Relay X] Number of Switches**") and the maximum number of switches carried out in a minute ("**[Relay X] Maximum Switches per Minute**").

2.2 OUTPUTS

MAXinBOX 24 / MAXinBOX 16 v3 / MAXinBOX 8 v3 actuator incorporates **24 / 16 / 8 relay outputs**, which can be configured as:

- **Individual binary outputs**, which allows an independent control of loads (it is possible to control up to 24 / 16 / 8 different loads, respectively).
- **Shutter channels**, which allow controlling the motion of shutters or blinds (it is possible to control up to 12 / 8 / 4 independent shutter channels, respectively).
- **Fan Coil modules**, which allow the control of the fan and the valve of two-pipe fan coil units (it is possible to control up to 6 / 4 / 2 independent fancoil blocks, respectively).

For detailed information about the functionality and the configuration of the related parameters, please refer to the following specific manuals, all of them available within the MAXinBOX 24 / MAXinBOX 16 v3 / MAXinBOX 8 v3 product section at the Zennio website (www.zennio.com):

- **Individual outputs.**
- **Shutter channels.**
- **'Relays' Fan Coil.** Note that these devices only support two-pipe fan coils with On/Off valves. Therefore, any references to four-pipe fan coils and 3-Point valves do not apply to them.

2.3 LOGIC FUNCTIONS

This module makes it possible to perform numeric and binary operations to incoming values received from the KNX bus, and to send the results through other communication objects specifically enabled for this purpose.

Up to 30 (in MAXinBOX 24) / **20** (in MAXinBOX 16 / 8 v3) **different and independent functions** can be implemented, each of them entirely customisable and consisting in **up to 4 consecutive operations each one**.

The execution of each function can depend on a configurable **condition**, which will be evaluated every time the function is **triggered** through specific, parameterisable communication objects. The result after executing the operations of the function can also be evaluated according to certain **conditions** and afterwards sent (or not) to the KNX bus, which can be done every time the function is executed, periodically or only when the result differs from the last one.

Please refer to the “**Logic Functions**” user manual, available within the MAXinBOX 24 / MAXinBOX 16 v3 / MAXinBOX 8 v3 product section at the Zennio homepage, www.zennio.com, for detailed information about the functionality and the configuration of the related parameters.

2.4 MASTER LIGHT

MAXinBOX 24 implements **two Master Light** which can be enabled and configured independently.

The Master Light function brings the option to monitor the state of up to 12 light sources (or even more, if the Master Light controls from multiple Zennio devices are linked together) or of any other elements whose state is transmitted through a binary object and, depending on those states, perform a **master order** every time a certain trigger signal (again, a binary value) is received through a specific object.

Such master order will consist in:

- A **general switch-off** order, if at least one of the up to twelve status objects is found to be on.
- A **courtesy switch-on** order, if none of the up to twelve status objects is found to be on.

Note that the above switch-off and switch-on orders are not necessarily a binary value being sent to the bus – it is up to the integrator the decision of what to send to the KNX bus in both cases: a shutter order, a thermostat setpoint or mode switch order, a constant value, a scene... Only the trigger object and the twelve status objects are required to be binary (on/off).

The most typical scenario for this Master Light control would be a hotel room with a master pushbutton next to the door. When leaving the room, the guest will have the possibility of pressing on the master pushbutton and make all the lamps turn off together. Afterwards, back on the room and with all the lamps off, pressing on the same master pushbutton will only make a particular lamp turn on (e.g., the closest lamp to the door) – this is the courtesy switch-on.

Besides, it is possible to concatenate two or more Master Light modules by means of a specific communication object which represents the general state of the light sources of each module. Thereby, it is possible to expand the number of light sources by considering the general state of one module as an additional light source for another.

ETS PARAMETERISATION

Once the Master Light function has been enabled, a specific tab will be included in the menu on the left. This new parameter screen contains the following options:

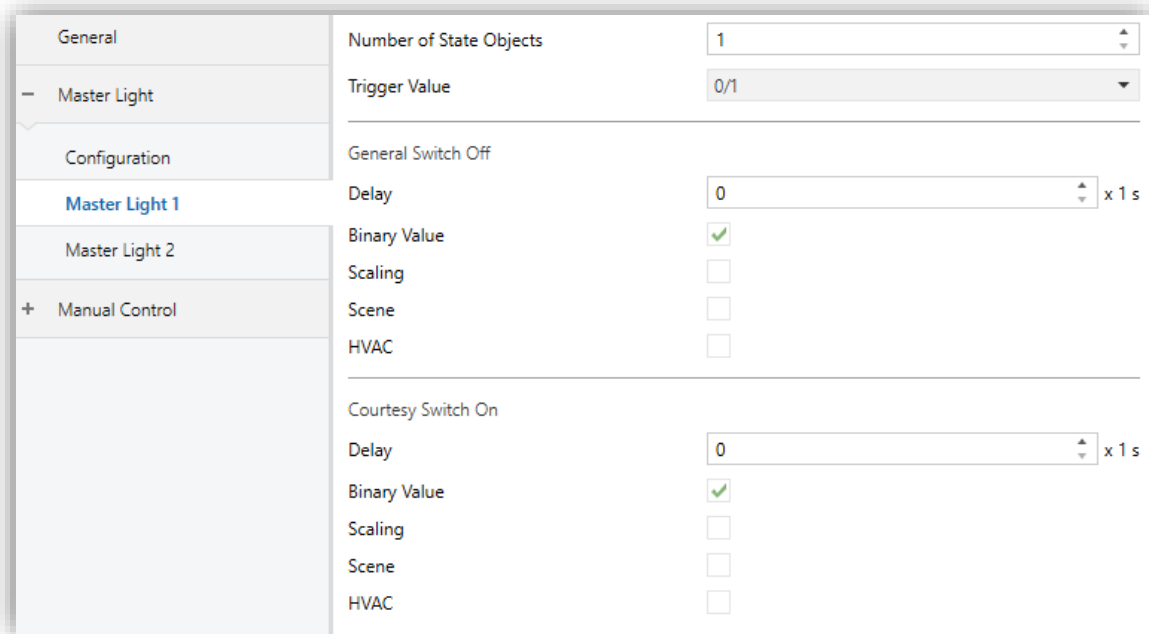


Figure 6. Master Light.

- **Number of State Objects** [1...12]: defines the number of 1-bit status objects required. These objects are called “[ML] Status Object *n*”.

In addition, the general status object (“[ML] General status”) will always be available in the project topology. It will be sent to the bus with a value of “1” whenever there is at least one of the above state objects with such value. Otherwise (i.e., if none of them has a value of “1”), it will be sent with a value of “0”.

- **Trigger Value** [0 / 1 / 0/1]: sets the value that will trigger, when received through “[ML] Trigger”, the master action (the general switch-off or the courtesy switch-on).

- **General Switch-Off.**

- **Delay** [0...255] [x 1 s]: defines a certain delay (once the trigger has been received) before the execution of the general switch-off. The allowed range is 0 to 255 seconds.

- **Binary Value** [*disabled/enabled*]: if checked, object “[ML] General Switch-off: Binary Object” will be enabled, which will send one “0” whenever the general switch-off takes off.
- **Scaling** [*disabled/enabled*]: if checked, object “[ML] General Switch-off: Scaling” will be enabled, which will send a percentage value (configurable in **Value** [*0...100*]) whenever the general switch-off takes off.
- **Scene** [*disabled/enabled*]: if checked, object “[ML] General Switch-off: Scene” will be enabled, which will send a scene run / save order (configurable in **Action** [*Run / Save*] and **Scene Number** [*1...64*]) whenever the general switch-off takes off
- **HVAC** [*disabled/enabled*]: if checked, object “[ML] General Switch-off: HVAC mode” will be enabled, which will send an HVAC thermostat mode value (configurable in **Value** [*Auto / Comfort / Standby / Economy / Building Protection*]) whenever the general switch-off takes off.

Note: *the above options are not mutually exclusive; it is possible to send values of different nature together.*

● **Courtesy Switch-On:**

The parameters available here are entirely analogous to those already mentioned for General Switch-Off. However, in this case the names of the objects start with “[ML] Courtesy Switch-On (...)”. On the other hand, sending **scene save orders** is not possible for the courtesy switch-on (only orders to play scenes are allowed).

Note: *object “[ML] Courtesy Switch-On: Binary Object” sends the value “1” (when the courtesy switch-on takes place), in contrast to object “[ML] General Switch-Off: Binary Object”, which sends the value “0” (during the general switch-off, as explained above).*

2.5 SCENE TEMPORISATION

The scene temporisation allows imposing **delays over the scenes of the outputs**. These delays are defined in parameters and can be applied to the execution of one or more scenes that may have been configured.

Please bear in mind that, as multiple delayed scenes can be configured for each individual output / shutter channel / fan coil module, in case of receiving an order to execute one of them when a previous temporisation is still pending for that output / channel / module, such temporisation will be interrupted and only the delay and the action of the new scene will be executed.

ETS PARAMETERISATION

Prior to setting the **scene temporisation**, it is necessary to have one or more scenes configured in some of the outputs. When entering the Configuration window under Scene Temporization, all configured scenes will be listed, together with a few checkboxes to select which of them need to be temporised, as shown in Figure 7.

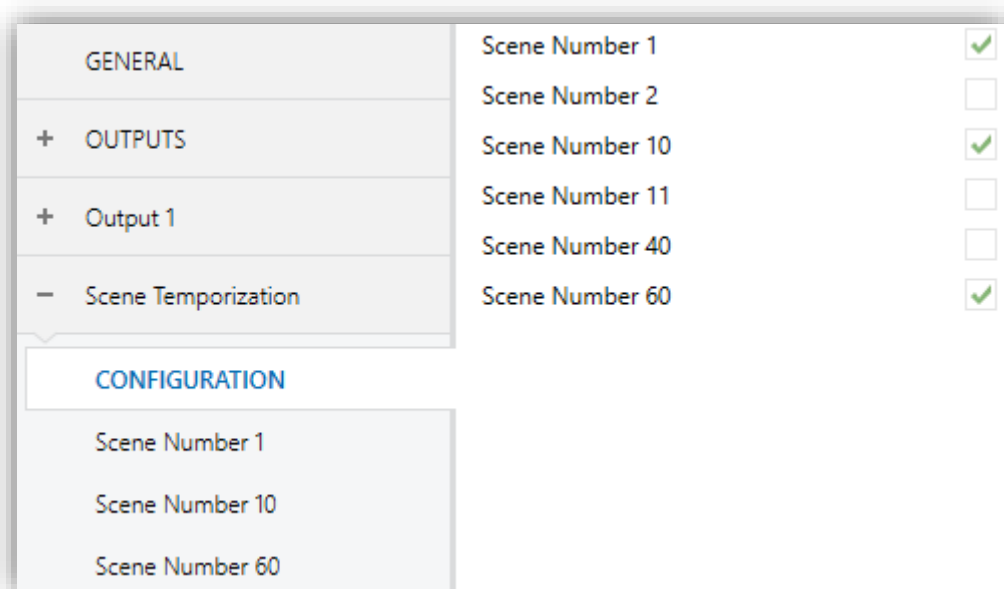


Figure 7. Scene Temporization

Enabling a certain scene number n brings a new tab with such name to the menu on the left, from which it is possible to configure the temporisation of that scene for each of the outputs where it has been configured.

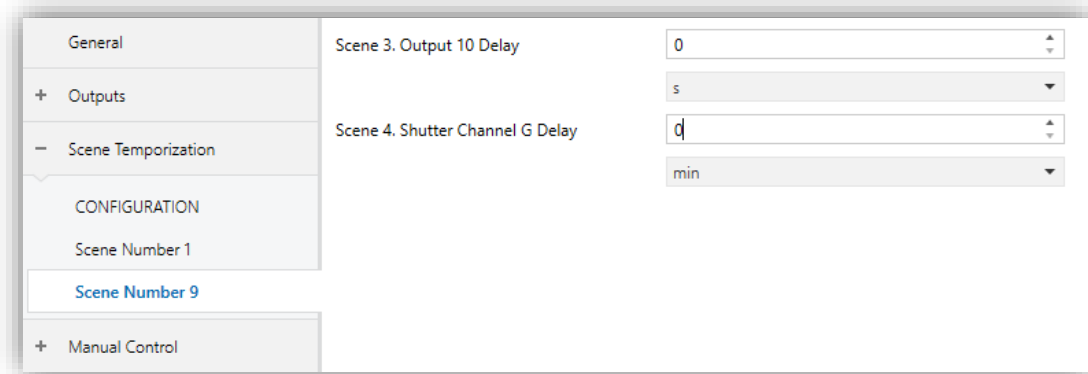


Figure 8. Configuration of Scene Temporization

Therefore, parameter “**Scene m. Z Delay**” [$0...3600$ [s] / $0...1440$ [min] / $0...24$ [h]], defines the delay that will be applied to the action defined in Z for the execution of scene m (where Z may be a specific individual output, shutter channel or fan coil module).

Note: *In the configuration of a scene of an output / shutter channel / fancoil it is possible to parameterize several scenes with the same scene number. This means that several delay parameters associated with the same output appear in the configuration tab of the delays of that scene. With this parameterization, the behavior will be as follows: the action and delay of the first scene parameterized with the same scene number will always prevail, where the highest priority scene is 1 (the first in the scene configuration tab) and the lowest priority is the last.*

2.6 MANUAL CONTROL

MAXinBOX allows manually switching the state of its output relays through the respective pushbuttons on the top of the device. A specific pushbutton is therefore available per output.

Manual operation can be done in two different ways, named as **Test On mode** (for testing purposes during the configuration of the device) and **Test Off mode** (for a normal use, anytime). Whether both, only one, or none of these modes should be accessible needs to be parameterised in ETS. Moreover, it is possible to enable a specific binary object for locking and unlocking the manual control in runtime.

Notes:

- *The **Test Off mode** will be active (unless it has been disabled by parameter) after a download or a reset with no need of a specific activation – the pushbuttons will respond to user presses from the start.*
- *On the contrary, switching to the **Test On mode** (unless disabled by parameter) needs to be done by long pressing the Prog/Test button (for at least three seconds), until the LED is no longer red and turns yellow. From that moment, once the button is released, the LED light will remain green to confirm that the device has switched from the Test Off mode to the Test On mode. After that, an additional press will turn the LED yellow and then off, once the button is released. This way, the device leaves the Test On mode. Note that it will also leave this mode if a bus power failure takes place or if a manual control lock is sending from KNX bus.*

Test Off Mode



Under the Test Off Mode, the outputs can be controlled through both their communication objects and the actual pushbuttons located on the top of the device.

When one of these buttons is pressed, the output will behave as if an order had been received through the corresponding communication object, depending on whether the output is configured as either an individual output, as a shutter channel or as a fan coil.

- **Individual output:** a simple press (short or long) will make the output switch

its on-off state, which will be reported to the KNX bus through the corresponding status object, if enabled.

- **Shutter Channel:** when the button is pressed, the device will act over the output according to the length of the button press and to the current state.
 - A **long press** makes the shutter start moving (upwards or downwards, depending on the button being pressed). The LED will light in green until the end of the motion. If the button gets pressed being the shutter already at the top or bottom positions, nothing will happen (the LED will not light).
 - A **short press** will make the shutter drive stop (if in motion), as it normally does when a step/stop order is received from the KNX bus. In case of not being the shutter in motion, pressing the button does not cause any action, unless slats/lamellas have been parameterized – in such case, a step movement (up/down, depending on the button pressed) will take place. The status objects will be sent to the bus when corresponding.

- **Fan Coil module:** the behaviour will depend on whether a fan-labelled  or a valve-labelled  button is pressed:
 - **Fan:** for this type of buttons, it must be considered that there are two types of control for the fan speed:
 - **Switching control:** a short or long press will switch the relays to set the selected speed, unless it matches the current speed – in such case all the relays will be opened (speed 0). The associated LEDs will indicate the state of the fan speed control relays (on = relay closed; off = relay open).
 - **Accumulation control:** a short or long press switch to the selected speed, closing the relay associated with that speed, and the relays assigned to the lower speeds, unless it matches the current speed – in such case all the relays will be opened (speed 0). The associated LEDs will indicate the state of the fan speed control relays (on = relay closed; off = relay open).

Note: *the behaviour of the relays will depend on the parameterisation, i.e., on the **number of fan speeds**, and on the **delay** between switches.*

- **Valve:** a short or long press will switch the current status of the relay and therefore of the valve. The LED will show the state of the relay anytime (on = relay closed; off = relay open).
- **Disabled output:** outputs disabled by parameter will not react to button presses under the Test Off mode.

Regarding the lock, timer, alarm and scene functions, the device will behave under the Test Off mode as usual. Button presses during this mode are entirely analogous to the reception of the corresponding orders from the KNX bus.

Test On Mode

After entering the Test On mode, it will only be possible to control the outputs through the on-board pushbuttons. Orders received through communication objects will be ignored, with independence of the channel or the output they are addressed to.

Depending on whether the output has been parameterized as an individual output or as part of a shutter channel, the reactions to the button presses will differ.

- **Individual output:** short or long pressing the button will commute the on-off state of the relay.
- **Shutter channel:** pressing the button will make the shutter drive move upward or downward (depending on the button) until the button is released again, thus ignoring the position of the shutter and the parameterized times. For safety reasons, only one closed relay per shutter channel is allowed.

Note: *after leaving the Test On mode, the status objects will recover the values they had prior to entering Test On. As the device is never aware of the actual position of the shutter (as the shutter drive does not provide any feedback), these values may not show the real position. This can be solved by performing a complete move-up or move-down order, or by calibrating the shutter position in the Test On mode until it matches the status objects.*

- **Fan Coil module:** the behaviour is similar to that of the Test Off mode, although in this case the three fan speeds are supposed available.
- **Disabled output:** short and long presses will switch the state of the corresponding relay. In case this consists in closing the relay, then the remaining relays of its block will open, for safety reasons.

As described previously if the device is in Test On mode, any command sent from the KNX bus to the actuator will not affect the outputs and no status objects will be sent (only periodically timed objects such as Heartbeat, logic functions or master light will continue to be sent to the bus) while Test ON mode is active. However, in the case of the "Alarm" and "Block" objects, although in Test ON mode the actions received by each object are not considered, the evaluation of their status is carried out when exiting this mode, so that any change in the alarm status or blocking of the outputs while Test ON mode is active is taken into account when exiting this mode and is updated with the last status detected.

Important: *the device is delivered from factory with all the outputs disabled, and with both manual modes (Test Off and Test On) enabled.*

ETS PARAMETERISATION

The **Manual Control** is configured from the Configuration tab itself under Manual Control.

The only two parameters are:

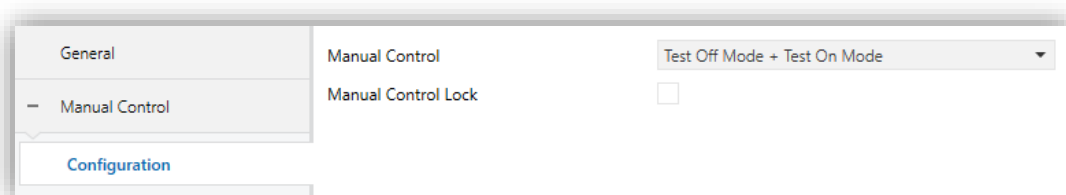


Figure 9. Manual Control

- **Manual Control** [Disabled / Only Test Off Mode / Only Test On Mode / Test Off Mode + Test On Mode]. Depending on the selection, the device will permit using the manual control under the Test Off, the Test On, or both modes. Note

that, as stated before, using the Test Off mode does not require any special action, while switching to the Test On mode does require long pressing the Prog/Test button.

- **Manual Control Lock** [*enabled/disabled*]: unless the above parameter has been “Disabled”, the Lock Manual Control parameter provides an optional procedure for locking the manual control in runtime. When this checkbox is enabled, object “**Manual Control Lock**” turns visible, as well as two more parameters:
 - **Value** [*0 = Lock; 1 = Unlock / 0 = Unlock; 1 = Lock*]: defines whether the manual control lock/unlock should take place respectively upon the reception (through the aforementioned object) of values “0” and “1”, or the opposite.
 - **Initialization** [*Unlocked / Locked / Last Value*]: sets how the lock state of the manual control should remain after the device start-up (after an ETS download or a bus power failure). “Last Value” (default; on the very first start-up, this will be Unlocked).

ANNEX I. COMMUNICATION OBJECTS

- “Functional range” shows the values that, with independence of any other values permitted by the bus according to the object size, may be of any use or have a particular meaning because of the specifications or restrictions from both the KNX standard or the application programme itself.

Note: Some of the numbers in the first column are only applicable to MAXinBOX 16 v3 and/or MAXinBOX 24.

Number	Size	I/O	Flags	Data type (DPT)	Functional Range	Name	Function
1	1 Bit		C - - T -	DPT_Trigger	0/1	Reset 0	Voltage Recovery -> Sending of 0
2	1 Bit		C - - T -	DPT_Trigger	0/1	Reset 1	Voltage Recovery -> Sending of 1
3	1 Bit	I	C - W - -	DPT_Enable	0/1	Lock Manual Control	0 = Lock; 1 = Unlock
	1 Bit	I	C - W - -	DPT_Enable	0/1	Lock Manual Control	0 = Unlock; 1 = Lock
4	1 Bit		C - - T -	DPT_Trigger	0/1	[Heartbeat] Object to Send '1'	Sending of '1' Periodically
5, 16, 27, 38, 49, 60, 71, 82, 93, 104, 115, 126, 137, 148, 159, 170, 181, 192, 203, 214, 225, 236, 247, 258	1 Byte	I	C - W - -	DPT_SceneControl	0-63; 128-191	[Ox] Scenes	0 - 63 (Execute 1 - 64); 128 - 191 (Save 1 - 64)
6, 17, 28, 39, 50, 61, 72, 83, 94, 105, 116, 127, 138, 149, 160, 171, 182, 193, 204, 215, 226, 237, 248, 259	1 Bit	I	C - W - -	DPT_BinaryValue	0/1	[Ox] On/Off	N.O. (0=Open Relay; 1=Close Relay)
	1 Bit	I	C - W - -	DPT_BinaryValue	0/1	[Ox] On/Off	N.C. (0=Close Relay; 1= Open Relay)
7, 18, 29, 40, 51, 62, 73, 84, 95, 106, 117, 128, 139, 150, 161, 172, 183, 194, 205, 216, 227, 238, 249, 260	1 Bit	O	C R - T -	DPT_BinaryValue	0/1	[Ox] On/Off (Status)	0=Output Off; 1=Output On
8, 19, 30, 41, 52, 63, 74, 85, 96, 107, 118, 129, 140, 151, 162, 173, 184, 195, 206, 217, 228, 239, 250, 261	1 Bit	I	C - W - -	DPT_Enable	0/1	[Ox] Lock	0=Unlock; 1=Lock
9, 20, 31, 42, 53, 64, 75, 86, 97, 108, 119, 130, 141, 152, 163, 174, 185, 196, 207, 218, 229, 240, 251, 262	1 Bit	I	C - W - -	DPT_Start	0/1	[Ox] Timer	0=Switch Off; 1=Switch On

10, 21, 32, 43, 54, 65, 76, 87, 98, 109, 120, 131, 142, 153, 164, 175, 186, 197, 208, 219, 230, 241, 252, 263	1 Bit	I	C - W - -	DPT_Start	0/1	[Ox] Flashing	0=Stop; 1=Start
11, 22, 33, 44, 55, 66, 77, 88, 99, 110, 121, 132, 143, 154, 165, 176, 187, 198, 209, 220, 231, 242, 253, 264	1 Bit	I	C - W - -	DPT_Alarm	0/1	[Ox] Alarm	0=Normal; 1=Alarm
	1 Bit	I	C - W - -	DPT_Alarm	0/1	[Ox] Alarm	0=Alarm; 1=Normal
12, 23, 34, 45, 56, 67, 78, 89, 100, 111, 122, 133, 144, 155, 166, 177, 188, 199, 210, 221, 232, 243, 254, 265	1 Bit	I	C - W - -	DPT_Ack	0/1	[Ox] Unfreeze Alarm	Alarm=0 + Unfreeze=1 => End Alarm
13, 24, 35, 46, 57, 68, 79, 90, 101, 112, 123, 134, 145, 156, 167, 178, 189, 200, 211, 222, 233, 244, 255, 266	1 Bit	O	C R - T -	DPT_State	0/1	[Ox] Warning Time (Status)	0=Normal; 1=Warning
14, 25, 36, 47, 58, 69, 80, 91, 102, 113, 124, 135, 146, 157, 168, 179, 190, 201, 212, 223, 234, 245, 256, 267	4 Bytes	I/O	C R W T -	DPT_LongDeltaTimeSec	-2147483648 - 2147483647	[Ox] Operating Time (s)	Time in Seconds
15, 26, 37, 48, 59, 70, 81, 92, 103, 114, 125, 136, 147, 158, 169, 180, 191, 202, 213, 224, 235, 246, 257, 268	2 Bytes	I/O	C R W T -	DPT_TimePeriodHrs	0 - 65535	[Ox] Operating Time (h)	Time in Hours
269	1 Byte	I	C - W - -	DPT_SceneControl	0-63; 128-191	[Shutter] Scenes	0 - 63 (Execute 1 - 64); 128 - 191 (Save 1 - 64)
270	1 Bit	I	C - W - -	DPT_UpDown	0/1	[CA] Move	0 = Raise; 1 = Lower
271	1 Bit	I	C - W - -	DPT_Step	0/1	[CA] Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CA] Stop	0 = Stop; 1 = Stop
272	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CA] Switched Control	0, 1 = Up, Down or Stop, Depending on the Last Move
273	1 Bit	I	C - W - -	DPT_Enable	0/1	[CA] Lock	0 = Unlock; 1 = Lock
274	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CA] Shutter Positioning	0% = Top; 100% = Bottom
275	1 Byte	O	C R - T -	DPT_Scaling	0% - 100%	[CA] Shutter Position (Status)	0% = Top; 100% = Bottom
276	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CA] Slats Positioning	0% = Open; 100% = Closed
277	1 Byte	O	C R - T -	DPT_Scaling	0% - 100%	[CA] Slats Position (Status)	0% = Open; 100% = Closed
278	1 Bit	O	C R - T -	DPT_Switch	0/1	[CA] Rising Relay (Status)	0 = Open; 1 = Closed
279	1 Bit	O	C R - T -	DPT_Switch	0/1	[CA] Lowering Relay (Status)	0 = Open; 1 = Closed
280	1 Bit	O	C R - T -	DPT_Switch	0/1	[CA] Movement (Status)	0 = Stopped; 1 = Moving
281	1 Bit	O	C R - T -	DPT_UpDown	0/1	[CA] Movement Direction (Status)	0 = Upward; 1 = Downward

282	1 Bit	I	C - W - -	DPT_Switch	0/1	[CA] Auto: On/Off	0 = On; 1 = Off
	1 Bit	I	C - W - -	DPT_Switch	0/1	[CA] Auto: On/Off	0 = Off; 1 = On
283	1 Bit	O	CR - T -	DPT_Switch	0/1	[CA] Auto: On/Off (Status)	0 = On; 1 = Off
	1 Bit	O	CR - T -	DPT_Switch	0/1	[CA] Auto: On/Off (Status)	0 = Off; 1 = On
284	1 Bit	I	C - W - -	DPT_UpDown	0/1	[CA] Auto: Move	0 = Raise; 1 = Lower
285	1 Bit	I	C - W - -	DPT_Step	0/1	[CA] Auto: Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CA] Auto: Stop	0 = Stop; 1 = Stop
286	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CA] Auto: Shutter Positioning	0% = Top; 100% = Bottom
287	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CA] Auto: Slats Positioning	0% = Open; 100% = Closed
288	1 Bit	I	C - WTU	DPT_Scene_AB	0/1	[CA] Sunshine/Shadow	0 = Sunshine; 1 = Shadow
	1 Bit	I	C - WTU	DPT_Scene_AB	0/1	[CA] Sunshine/Shadow	0 = Shadow; 1 = Sunshine
289	1 Bit	I	C - WTU	DPT_Heat_Cool	0/1	[CA] Cooling/Heating	0 = Heating; 1 = Cooling
	1 Bit	I	C - WTU	DPT_Heat_Cool	0/1	[CA] Cooling/Heating	0 = Cooling; 1 = Heating
290	1 Bit	I	C - WTU	DPT_Occupancy	0/1	[CA] Presence/No Presence	0 = Presence; 1 = No Presence
	1 Bit	I	C - WTU	DPT_Occupancy	0/1	[CA] Presence/No Presence	0 = No Presence; 1 = Presence
291, 292	1 Bit	I	C - W - -	DPT_Alarm	0/1	[CA] Alarm x	0 = No Alarm; 1 = Alarm
	1 Bit	I	C - W - -	DPT_Alarm	0/1	[CA] Alarm x	0 = Alarm; 1 = No Alarm
293	1 Bit	I	C - W - -	DPT_Ack	0/1	[CA] Unfreeze Alarm	Alarm1 = Alarm2 = No Alarm + Unfreeze (1) => End Alarm
294	1 Bit	I	C - W - -	DPT_Scene_AB	0/1	[CA] Move (Reversed)	0 = Lower; 1 = Raise
295	1 Bit	I	C - W - -	DPT_Ack	0/1	[CA] Direct Positioning 1	0 = No Action; 1 = Go to Position
296	1 Bit	I	C - W - -	DPT_Ack	0/1	[CA] Direct Positioning 2	0 = No Action; 1 = Go to Position
297	1 Bit	I	C - W - -	DPT_Ack	0/1	[CA] Direct Positioning 1 (Save)	0 = No Action; 1 = Save Current Position
298	1 Bit	I	C - W - -	DPT_Ack	0/1	[CA] Direct Positioning 2 (Save)	0 = No Action; 1 = Save Current Position
299	1 Bit	I	C - W - -	DPT_UpDown	0/1	[CB] Move	0 = Raise; 1 = Lower
300	1 Bit	I	C - W - -	DPT_Step	0/1	[CB] Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CB] Stop	0 = Stop; 1 = Stop
301	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CB] Switched Control	0, 1 = Up, Down or Stop, Depending on the Last Move
302	1 Bit	I	C - W - -	DPT_Enable	0/1	[CB] Lock	0 = Unlock; 1 = Lock
303	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CB] Shutter Positioning	0% = Top; 100% = Bottom
304	1 Byte	O	CR - T -	DPT_Scaling	0% - 100%	[CB] Shutter Position (Status)	0% = Top; 100% = Bottom

305	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CB] Slats Positioning	0% = Open; 100% = Closed
306	1 Byte	O	CR - T -	DPT_Scaling	0% - 100%	[CB] Slats Position (Status)	0% = Open; 100% = Closed
307	1 Bit	O	CR - T -	DPT_Switch	0/1	[CB] Rising Relay (Status)	0 = Open; 1 = Closed
308	1 Bit	O	CR - T -	DPT_Switch	0/1	[CB] Lowering Relay (Status)	0 = Open; 1 = Closed
309	1 Bit	O	CR - T -	DPT_Switch	0/1	[CB] Movement (Status)	0 = Stopped; 1 = Moving
310	1 Bit	O	CR - T -	DPT_UpDown	0/1	[CB] Movement Direction (Status)	0 = Upward; 1 = Downward
311	1 Bit	I	C - W - -	DPT_Switch	0/1	[CB] Auto: On/Off	0 = On; 1 = Off
	1 Bit	I	C - W - -	DPT_Switch	0/1	[CB] Auto: On/Off	0 = Off; 1 = On
312	1 Bit	O	CR - T -	DPT_Switch	0/1	[CB] Auto: On/Off (Status)	0 = On; 1 = Off
	1 Bit	O	CR - T -	DPT_Switch	0/1	[CB] Auto: On/Off (Status)	0 = Off; 1 = On
313	1 Bit	I	C - W - -	DPT_UpDown	0/1	[CB] Auto: Move	0 = Raise; 1 = Lower
314	1 Bit	I	C - W - -	DPT_Step	0/1	[CB] Auto: Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CB] Auto: Stop	0 = Stop; 1 = Stop
315	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CB] Auto: Shutter Positioning	0% = Top; 100% = Bottom
316	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CB] Auto: Slats Positioning	0% = Open; 100% = Closed
317	1 Bit	I	C - W T U	DPT_Scene_AB	0/1	[CB] Sunshine/Shadow	0 = Sunshine; 1 = Shadow
	1 Bit	I	C - W T U	DPT_Scene_AB	0/1	[CB] Sunshine/Shadow	0 = Shadow; 1 = Sunshine
318	1 Bit	I	C - W T U	DPT_Heat_Cool	0/1	[CB] Cooling/Heating	0 = Heating; 1 = Cooling
	1 Bit	I	C - W T U	DPT_Heat_Cool	0/1	[CB] Cooling/Heating	0 = Cooling; 1 = Heating
319	1 Bit	I	C - W T U	DPT_Occupancy	0/1	[CB] Presence/No Presence	0 = Presence; 1 = No Presence
	1 Bit	I	C - W T U	DPT_Occupancy	0/1	[CB] Presence/No Presence	0 = No Presence; 1 = Presence
320, 321	1 Bit	I	C - W - -	DPT_Alarm	0/1	[CB] Alarm x	0 = No Alarm; 1 = Alarm
	1 Bit	I	C - W - -	DPT_Alarm	0/1	[CB] Alarm x	0 = Alarm; 1 = No Alarm
322	1 Bit	I	C - W - -	DPT_Ack	0/1	[CB] Unfreeze Alarm	Alarm1 = Alarm2 = No Alarm + Unfreeze (1) => End Alarm
323	1 Bit	I	C - W - -	DPT_Scene_AB	0/1	[CB] Move (Reversed)	0 = Lower; 1 = Raise
324	1 Bit	I	C - W - -	DPT_Ack	0/1	[CB] Direct Positioning 1	0 = No Action; 1 = Go to Position
325	1 Bit	I	C - W - -	DPT_Ack	0/1	[CB] Direct Positioning 2	0 = No Action; 1 = Go to Position
326	1 Bit	I	C - W - -	DPT_Ack	0/1	[CB] Direct Positioning 1 (Save)	0 = No Action; 1 = Save Current Position
327	1 Bit	I	C - W - -	DPT_Ack	0/1	[CB] Direct Positioning 2 (Save)	0 = No Action; 1 = Save Current Position
328	1 Bit	I	C - W - -	DPT_UpDown	0/1	[CC] Move	0 = Raise; 1 = Lower
329	1 Bit	I	C - W - -	DPT_Step	0/1	[CC] Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown

	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CC] Stop	0 = Stop; 1 = Stop
330	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CC] Switched Control	0, 1 = Up, Down or Stop, Depending on the Last Move
331	1 Bit	I	C - W - -	DPT_Enable	0/1	[CC] Lock	0 = Unlock; 1 = Lock
332	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CC] Shutter Positioning	0% = Top; 100% = Bottom
333	1 Byte	O	CR - T -	DPT_Scaling	0% - 100%	[CC] Shutter Position (Status)	0% = Top; 100% = Bottom
334	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CC] Slats Positioning	0% = Open; 100% = Closed
335	1 Byte	O	CR - T -	DPT_Scaling	0% - 100%	[CC] Slats Position (Status)	0% = Open; 100% = Closed
336	1 Bit	O	CR - T -	DPT_Switch	0/1	[CC] Rising Relay (Status)	0 = Open; 1 = Closed
337	1 Bit	O	CR - T -	DPT_Switch	0/1	[CC] Lowering Relay (Status)	0 = Open; 1 = Closed
338	1 Bit	O	CR - T -	DPT_Switch	0/1	[CC] Movement (Status)	0 = Stopped; 1 = Moving
339	1 Bit	O	CR - T -	DPT_UpDown	0/1	[CC] Movement Direction (Status)	0 = Upward; 1 = Downward
340	1 Bit	I	C - W - -	DPT_Switch	0/1	[CC] Auto: On/Off	0 = On; 1 = Off
	1 Bit	I	C - W - -	DPT_Switch	0/1	[CC] Auto: On/Off	0 = Off; 1 = On
341	1 Bit	O	CR - T -	DPT_Switch	0/1	[CC] Auto: On/Off (Status)	0 = On; 1 = Off
	1 Bit	O	CR - T -	DPT_Switch	0/1	[CC] Auto: On/Off (Status)	0 = Off; 1 = On
342	1 Bit	I	C - W - -	DPT_UpDown	0/1	[CC] Auto: Move	0 = Raise; 1 = Lower
343	1 Bit	I	C - W - -	DPT_Step	0/1	[CC] Auto: Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CC] Auto: Stop	0 = Stop; 1 = Stop
344	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CC] Auto: Shutter Positioning	0% = Top; 100% = Bottom
345	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CC] Auto: Slats Positioning	0% = Open; 100% = Closed
346	1 Bit	I	C - W T U	DPT_Scene_AB	0/1	[CC] Sunshine/Shadow	0 = Sunshine; 1 = Shadow
	1 Bit	I	C - W T U	DPT_Scene_AB	0/1	[CC] Sunshine/Shadow	0 = Shadow; 1 = Sunshine
347	1 Bit	I	C - W T U	DPT_Heat_Cool	0/1	[CC] Cooling/Heating	0 = Heating; 1 = Cooling
	1 Bit	I	C - W T U	DPT_Heat_Cool	0/1	[CC] Cooling/Heating	0 = Cooling; 1 = Heating
348	1 Bit	I	C - W T U	DPT_Occupancy	0/1	[CC] Presence/No Presence	0 = Presence; 1 = No Presence
	1 Bit	I	C - W T U	DPT_Occupancy	0/1	[CC] Presence/No Presence	0 = No Presence; 1 = Presence
349, 350	1 Bit	I	C - W - -	DPT_Alarm	0/1	[CC] Alarm x	0 = No Alarm; 1 = Alarm
	1 Bit	I	C - W - -	DPT_Alarm	0/1	[CC] Alarm x	0 = Alarm; 1 = No Alarm
351	1 Bit	I	C - W - -	DPT_Ack	0/1	[CC] Unfreeze Alarm	Alarm1 = Alarm2 = No Alarm + Unfreeze (1) => End Alarm
352	1 Bit	I	C - W - -	DPT_Scene_AB	0/1	[CC] Move (Reversed)	0 = Lower; 1 = Raise
353	1 Bit	I	C - W - -	DPT_Ack	0/1	[CC] Direct Positioning 1	0 = No Action; 1 = Go to Position
354	1 Bit	I	C - W - -	DPT_Ack	0/1	[CC] Direct Positioning 2	0 = No Action; 1 = Go to Position

355	1 Bit	I	C - W - -	DPT_Ack	0/1	[CC] Direct Positioning 1 (Save)	0 = No Action; 1 = Save Current Position
356	1 Bit	I	C - W - -	DPT_Ack	0/1	[CC] Direct Positioning 2 (Save)	0 = No Action; 1 = Save Current Position
357	1 Bit	I	C - W - -	DPT_UpDown	0/1	[CD] Move	0 = Raise; 1 = Lower
358	1 Bit	I	C - W - -	DPT_Step	0/1	[CD] Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CD] Stop	0 = Stop; 1 = Stop
359	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CD] Switched Control	0, 1 = Up, Down or Stop, Depending on the Last Move
360	1 Bit	I	C - W - -	DPT_Enable	0/1	[CD] Lock	0 = Unlock; 1 = Lock
361	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CD] Shutter Positioning	0% = Top; 100% = Bottom
362	1 Byte	O	CR - T -	DPT_Scaling	0% - 100%	[CD] Shutter Position (Status)	0% = Top; 100% = Bottom
363	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CD] Slats Positioning	0% = Open; 100% = Closed
364	1 Byte	O	CR - T -	DPT_Scaling	0% - 100%	[CD] Slats Position (Status)	0% = Open; 100% = Closed
365	1 Bit	O	CR - T -	DPT_Switch	0/1	[CD] Rising Relay (Status)	0 = Open; 1 = Closed
366	1 Bit	O	CR - T -	DPT_Switch	0/1	[CD] Lowering Relay (Status)	0 = Open; 1 = Closed
367	1 Bit	O	CR - T -	DPT_Switch	0/1	[CD] Movement (Status)	0 = Stopped; 1 = Moving
368	1 Bit	O	CR - T -	DPT_UpDown	0/1	[CD] Movement Direction (Status)	0 = Upward; 1 = Downward
	1 Bit	I	C - W - -	DPT_Switch	0/1	[CD] Auto: On/Off	0 = On; 1 = Off
369	1 Bit	I	C - W - -	DPT_Switch	0/1	[CD] Auto: On/Off	0 = Off; 1 = On
	1 Bit	O	CR - T -	DPT_Switch	0/1	[CD] Auto: On/Off (Status)	0 = On; 1 = Off
370	1 Bit	O	CR - T -	DPT_Switch	0/1	[CD] Auto: On/Off (Status)	0 = Off; 1 = On
	1 Bit	I	C - W - -	DPT_UpDown	0/1	[CD] Auto: Move	0 = Raise; 1 = Lower
371	1 Bit	I	C - W - -	DPT_Step	0/1	[CD] Auto: Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CD] Auto: Stop	0 = Stop; 1 = Stop
372	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CD] Auto: Shutter Positioning	0% = Top; 100% = Bottom
373	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CD] Auto: Slats Positioning	0% = Open; 100% = Closed
374	1 Bit	I	C - W T U	DPT_Scene_AB	0/1	[CD] Sunshine/Shadow	0 = Sunshine; 1 = Shadow
	1 Bit	I	C - W T U	DPT_Scene_AB	0/1	[CD] Sunshine/Shadow	0 = Shadow; 1 = Sunshine
375	1 Bit	I	C - W T U	DPT_Heat_Cool	0/1	[CD] Cooling/Heating	0 = Heating; 1 = Cooling
	1 Bit	I	C - W T U	DPT_Heat_Cool	0/1	[CD] Cooling/Heating	0 = Cooling; 1 = Heating
376	1 Bit	I	C - W T U	DPT_Occupancy	0/1	[CD] Presence/No Presence	0 = Presence; 1 = No Presence
	1 Bit	I	C - W T U	DPT_Occupancy	0/1	[CD] Presence/No Presence	0 = No Presence; 1 = Presence
377	1 Bit	I	C - W - -	DPT_Alarm	0/1	[CD] Alarm x	0 = No Alarm; 1 = Alarm
	1 Bit	I	C - W - -	DPT_Alarm	0/1	[CD] Alarm x	0 = Alarm; 1 = No Alarm

380	1 Bit	I	C - W - -	DPT_Ack	0/1	[CD] Unfreeze Alarm	Alarm1 = Alarm2 = No Alarm + Unfreeze (1) => End Alarm
381	1 Bit	I	C - W - -	DPT_Scene_AB	0/1	[CD] Move (Reversed)	0 = Lower; 1 = Raise
382	1 Bit	I	C - W - -	DPT_Ack	0/1	[CD] Direct Positioning 1	0 = No Action; 1 = Go to Position
383	1 Bit	I	C - W - -	DPT_Ack	0/1	[CD] Direct Positioning 2	0 = No Action; 1 = Go to Position
384	1 Bit	I	C - W - -	DPT_Ack	0/1	[CD] Direct Positioning 1 (Save)	0 = No Action; 1 = Save Current Position
385	1 Bit	I	C - W - -	DPT_Ack	0/1	[CD] Direct Positioning 2 (Save)	0 = No Action; 1 = Save Current Position
386	1 Bit	I	C - W - -	DPT_UpDown	0/1	[CE] Move	0 = Raise; 1 = Lower
387	1 Bit	I	C - W - -	DPT_Step	0/1	[CE] Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CE] Stop	0 = Stop; 1 = Stop
388	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CE] Switched Control	0, 1 = Up, Down or Stop, Depending on the Last Move
389	1 Bit	I	C - W - -	DPT_Enable	0/1	[CE] Lock	0 = Unlock; 1 = Lock
390	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CE] Shutter Positioning	0% = Top; 100% = Bottom
391	1 Byte	O	C R - T -	DPT_Scaling	0% - 100%	[CE] Shutter Position (Status)	0% = Top; 100% = Bottom
392	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CE] Slats Positioning	0% = Open; 100% = Closed
393	1 Byte	O	C R - T -	DPT_Scaling	0% - 100%	[CE] Slats Position (Status)	0% = Open; 100% = Closed
394	1 Bit	O	C R - T -	DPT_Switch	0/1	[CE] Rising Relay (Status)	0 = Open; 1 = Closed
395	1 Bit	O	C R - T -	DPT_Switch	0/1	[CE] Lowering Relay (Status)	0 = Open; 1 = Closed
396	1 Bit	O	C R - T -	DPT_Switch	0/1	[CE] Movement (Status)	0 = Stopped; 1 = Moving
397	1 Bit	O	C R - T -	DPT_UpDown	0/1	[CE] Movement Direction (Status)	0 = Upward; 1 = Downward
398	1 Bit	I	C - W - -	DPT_Switch	0/1	[CE] Auto: On/Off	0 = On; 1 = Off
	1 Bit	I	C - W - -	DPT_Switch	0/1	[CE] Auto: On/Off	0 = Off; 1 = On
399	1 Bit	O	C R - T -	DPT_Switch	0/1	[CE] Auto: On/Off (Status)	0 = On; 1 = Off
	1 Bit	O	C R - T -	DPT_Switch	0/1	[CE] Auto: On/Off (Status)	0 = Off; 1 = On
400	1 Bit	I	C - W - -	DPT_UpDown	0/1	[CE] Auto: Move	0 = Raise; 1 = Lower
401	1 Bit	I	C - W - -	DPT_Step	0/1	[CE] Auto: Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CE] Auto: Stop	0 = Stop; 1 = Stop
402	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CE] Auto: Shutter Positioning	0% = Top; 100% = Bottom
403	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CE] Auto: Slats Positioning	0% = Open; 100% = Closed
404	1 Bit	I	C - W T U	DPT_Scene_AB	0/1	[CE] Sunshine/Shadow	0 = Sunshine; 1 = Shadow
	1 Bit	I	C - W T U	DPT_Scene_AB	0/1	[CE] Sunshine/Shadow	0 = Shadow; 1 = Sunshine

405	1 Bit	I	C - W T U	DPT_Heat_Cool	0/1	[CE] Cooling/Heating	0 = Heating; 1 = Cooling
	1 Bit	I	C - W T U	DPT_Heat_Cool	0/1	[CE] Cooling/Heating	0 = Cooling; 1 = Heating
406	1 Bit	I	C - W T U	DPT_Occupancy	0/1	[CE] Presence/No Presence	0 = Presence; 1 = No Presence
	1 Bit	I	C - W T U	DPT_Occupancy	0/1	[CE] Presence/No Presence	0 = No Presence; 1 = Presence
407, 408	1 Bit	I	C - W - -	DPT_Alarm	0/1	[CE] Alarm x	0 = No Alarm; 1 = Alarm
	1 Bit	I	C - W - -	DPT_Alarm	0/1	[CE] Alarm x	0 = Alarm; 1 = No Alarm
409	1 Bit	I	C - W - -	DPT_Ack	0/1	[CE] Unfreeze Alarm	Alarm1 = Alarm2 = No Alarm + Unfreeze (1) => End Alarm
410	1 Bit	I	C - W - -	DPT_Scene_AB	0/1	[CE] Move (Reversed)	0 = Lower; 1 = Raise
411	1 Bit	I	C - W - -	DPT_Ack	0/1	[CE] Direct Positioning 1	0 = No Action; 1 = Go to Position
412	1 Bit	I	C - W - -	DPT_Ack	0/1	[CE] Direct Positioning 2	0 = No Action; 1 = Go to Position
413	1 Bit	I	C - W - -	DPT_Ack	0/1	[CE] Direct Positioning 1 (Save)	0 = No Action; 1 = Save Current Position
414	1 Bit	I	C - W - -	DPT_Ack	0/1	[CE] Direct Positioning 2 (Save)	0 = No Action; 1 = Save Current Position
415	1 Bit	I	C - W - -	DPT_UpDown	0/1	[CF] Move	0 = Raise; 1 = Lower
416	1 Bit	I	C - W - -	DPT_Step	0/1	[CF] Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CF] Stop	0 = Stop; 1 = Stop
417	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CF] Switched Control	0, 1 = Up, Down or Stop, Depending on the Last Move
418	1 Bit	I	C - W - -	DPT_Enable	0/1	[CF] Lock	0 = Unlock; 1 = Lock
419	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CF] Shutter Positioning	0% = Top; 100% = Bottom
420	1 Byte	O	C R - T -	DPT_Scaling	0% - 100%	[CF] Shutter Position (Status)	0% = Top; 100% = Bottom
421	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CF] Slats Positioning	0% = Open; 100% = Closed
422	1 Byte	O	C R - T -	DPT_Scaling	0% - 100%	[CF] Slats Position (Status)	0% = Open; 100% = Closed
423	1 Bit	O	C R - T -	DPT_Switch	0/1	[CF] Rising Relay (Status)	0 = Open; 1 = Closed
424	1 Bit	O	C R - T -	DPT_Switch	0/1	[CF] Lowering Relay (Status)	0 = Open; 1 = Closed
425	1 Bit	O	C R - T -	DPT_Switch	0/1	[CF] Movement (Status)	0 = Stopped; 1 = Moving
426	1 Bit	O	C R - T -	DPT_UpDown	0/1	[CF] Movement Direction (Status)	0 = Upward; 1 = Downward
427	1 Bit	I	C - W - -	DPT_Switch	0/1	[CF] Auto: On/Off	0 = On; 1 = Off
	1 Bit	I	C - W - -	DPT_Switch	0/1	[CF] Auto: On/Off	0 = Off; 1 = On
428	1 Bit	O	C R - T -	DPT_Switch	0/1	[CF] Auto: On/Off (Status)	0 = On; 1 = Off
	1 Bit	O	C R - T -	DPT_Switch	0/1	[CF] Auto: On/Off (Status)	0 = Off; 1 = On
429	1 Bit	I	C - W - -	DPT_UpDown	0/1	[CF] Auto: Move	0 = Raise; 1 = Lower

430	1 Bit	I	C - W - -	DPT_Step	0/1	[CF] Auto: Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CF] Auto: Stop	0 = Stop; 1 = Stop
431	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CF] Auto: Shutter Positioning	0% = Top; 100% = Bottom
432	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CF] Auto: Slats Positioning	0% = Open; 100% = Closed
433	1 Bit	I	C - W T U	DPT_Scene_AB	0/1	[CF] Sunshine/Shadow	0 = Sunshine; 1 = Shadow
	1 Bit	I	C - W T U	DPT_Scene_AB	0/1	[CF] Sunshine/Shadow	0 = Shadow; 1 = Sunshine
434	1 Bit	I	C - W T U	DPT_Heat_Cool	0/1	[CF] Cooling/Heating	0 = Heating; 1 = Cooling
	1 Bit	I	C - W T U	DPT_Heat_Cool	0/1	[CF] Cooling/Heating	0 = Cooling; 1 = Heating
435	1 Bit	I	C - W T U	DPT_Occupancy	0/1	[CF] Presence/No Presence	0 = Presence; 1 = No Presence
	1 Bit	I	C - W T U	DPT_Occupancy	0/1	[CF] Presence/No Presence	0 = No Presence; 1 = Presence
436, 437	1 Bit	I	C - W - -	DPT_Alarm	0/1	[CF] Alarm x	0 = No Alarm; 1 = Alarm
	1 Bit	I	C - W - -	DPT_Alarm	0/1	[CF] Alarm x	0 = Alarm; 1 = No Alarm
438	1 Bit	I	C - W - -	DPT_Ack	0/1	[CF] Unfreeze Alarm	Alarm1 = Alarm2 = No Alarm + Unfreeze (1) => End Alarm
439	1 Bit	I	C - W - -	DPT_Scene_AB	0/1	[CF] Move (Reversed)	0 = Lower; 1 = Raise
440	1 Bit	I	C - W - -	DPT_Ack	0/1	[CF] Direct Positioning 1	0 = No Action; 1 = Go to Position
441	1 Bit	I	C - W - -	DPT_Ack	0/1	[CF] Direct Positioning 2	0 = No Action; 1 = Go to Position
442	1 Bit	I	C - W - -	DPT_Ack	0/1	[CF] Direct Positioning 1 (Save)	0 = No Action; 1 = Save Current Position
443	1 Bit	I	C - W - -	DPT_Ack	0/1	[CF] Direct Positioning 2 (Save)	0 = No Action; 1 = Save Current Position
444	1 Bit	I	C - W - -	DPT_UpDown	0/1	[CG] Move	0 = Raise; 1 = Lower
445	1 Bit	I	C - W - -	DPT_Step	0/1	[CG] Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CG] Stop	0 = Stop; 1 = Stop
446	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CG] Switched Control	0, 1 = Up, Down or Stop, Depending on the Last Move
447	1 Bit	I	C - W - -	DPT_Enable	0/1	[CG] Lock	0 = Unlock; 1 = Lock
448	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CG] Shutter Positioning	0% = Top; 100% = Bottom
449	1 Byte	O	C R - T -	DPT_Scaling	0% - 100%	[CG] Shutter Position (Status)	0% = Top; 100% = Bottom
450	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CG] Slats Positioning	0% = Open; 100% = Closed
451	1 Byte	O	C R - T -	DPT_Scaling	0% - 100%	[CG] Slats Position (Status)	0% = Open; 100% = Closed
452	1 Bit	O	C R - T -	DPT_Switch	0/1	[CG] Rising Relay (Status)	0 = Open; 1 = Closed
453	1 Bit	O	C R - T -	DPT_Switch	0/1	[CG] Lowering Relay (Status)	0 = Open; 1 = Closed
454	1 Bit	O	C R - T -	DPT_Switch	0/1	[CG] Movement (Status)	0 = Stopped; 1 = Moving

455	1 Bit	O	C R - T -	DPT_UpDown	0/1	[CG] Movement Direction (Status)	0 = Upward; 1 = Downward
456	1 Bit	I	C - W - -	DPT_Switch	0/1	[CG] Auto: On/Off	0 = On; 1 = Off
	1 Bit	I	C - W - -	DPT_Switch	0/1	[CG] Auto: On/Off	0 = Off; 1 = On
457	1 Bit	O	C R - T -	DPT_Switch	0/1	[CG] Auto: On/Off (Status)	0 = On; 1 = Off
	1 Bit	O	C R - T -	DPT_Switch	0/1	[CG] Auto: On/Off (Status)	0 = Off; 1 = On
458	1 Bit	I	C - W - -	DPT_UpDown	0/1	[CG] Auto: Move	0 = Raise; 1 = Lower
459	1 Bit	I	C - W - -	DPT_Step	0/1	[CG] Auto: Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CG] Auto: Stop	0 = Stop; 1 = Stop
460	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CG] Auto: Shutter Positioning	0% = Top; 100% = Bottom
461	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CG] Auto: Slats Positioning	0% = Open; 100% = Closed
462	1 Bit	I	C - W T U	DPT_Scene_AB	0/1	[CG] Sunshine/Shadow	0 = Sunshine; 1 = Shadow
	1 Bit	I	C - W T U	DPT_Scene_AB	0/1	[CG] Sunshine/Shadow	0 = Shadow; 1 = Sunshine
463	1 Bit	I	C - W T U	DPT_Heat_Cool	0/1	[CG] Cooling/Heating	0 = Heating; 1 = Cooling
	1 Bit	I	C - W T U	DPT_Heat_Cool	0/1	[CG] Cooling/Heating	0 = Cooling; 1 = Heating
464	1 Bit	I	C - W T U	DPT_Occupancy	0/1	[CG] Presence/No Presence	0 = Presence; 1 = No Presence
	1 Bit	I	C - W T U	DPT_Occupancy	0/1	[CG] Presence/No Presence	0 = No Presence; 1 = Presence
465, 466	1 Bit	I	C - W - -	DPT_Alarm	0/1	[CG] Alarm x	0 = No Alarm; 1 = Alarm
	1 Bit	I	C - W - -	DPT_Alarm	0/1	[CG] Alarm x	0 = Alarm; 1 = No Alarm
467	1 Bit	I	C - W - -	DPT_Ack	0/1	[CG] Unfreeze Alarm	Alarm1 = Alarm2 = No Alarm + Unfreeze (1) => End Alarm
468	1 Bit	I	C - W - -	DPT_Scene_AB	0/1	[CG] Move (Reversed)	0 = Lower; 1 = Raise
469	1 Bit	I	C - W - -	DPT_Ack	0/1	[CG] Direct Positioning 1	0 = No Action; 1 = Go to Position
470	1 Bit	I	C - W - -	DPT_Ack	0/1	[CG] Direct Positioning 2	0 = No Action; 1 = Go to Position
471	1 Bit	I	C - W - -	DPT_Ack	0/1	[CG] Direct Positioning 1 (Save)	0 = No Action; 1 = Save Current Position
472	1 Bit	I	C - W - -	DPT_Ack	0/1	[CG] Direct Positioning 2 (Save)	0 = No Action; 1 = Save Current Position
473	1 Bit	I	C - W - -	DPT_UpDown	0/1	[CH] Move	0 = Raise; 1 = Lower
474	1 Bit	I	C - W - -	DPT_Step	0/1	[CH] Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CH] Stop	0 = Stop; 1 = Stop
475	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CH] Switched Control	0, 1 = Up, Down or Stop, Depending on the Last Move
476	1 Bit	I	C - W - -	DPT_Enable	0/1	[CH] Lock	0 = Unlock; 1 = Lock
477	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CH] Shutter Positioning	0% = Top; 100% = Bottom

478	1 Byte	O	C - R - T -	DPT_Scaling	0% - 100%	[CH] Shutter Position (Status)	0% = Top; 100% = Bottom
479	1 Byte	I	C - W - - -	DPT_Scaling	0% - 100%	[CH] Slats Positioning	0% = Open; 100% = Closed
480	1 Byte	O	C - R - T -	DPT_Scaling	0% - 100%	[CH] Slats Position (Status)	0% = Open; 100% = Closed
481	1 Bit	O	C - R - T -	DPT_Switch	0/1	[CH] Rising Relay (Status)	0 = Open; 1 = Closed
482	1 Bit	O	C - R - T -	DPT_Switch	0/1	[CH] Lowering Relay (Status)	0 = Open; 1 = Closed
483	1 Bit	O	C - R - T -	DPT_Switch	0/1	[CH] Movement (Status)	0 = Stopped; 1 = Moving
484	1 Bit	O	C - R - T -	DPT_UpDown	0/1	[CH] Movement Direction (Status)	0 = Upward; 1 = Downward
485	1 Bit	I	C - W - - -	DPT_Switch	0/1	[CH] Auto: On/Off	0 = On; 1 = Off
	1 Bit	I	C - W - - -	DPT_Switch	0/1	[CH] Auto: On/Off	0 = Off; 1 = On
486	1 Bit	O	C - R - T -	DPT_Switch	0/1	[CH] Auto: On/Off (Status)	0 = On; 1 = Off
	1 Bit	O	C - R - T -	DPT_Switch	0/1	[CH] Auto: On/Off (Status)	0 = Off; 1 = On
487	1 Bit	I	C - W - - -	DPT_UpDown	0/1	[CH] Auto: Move	0 = Raise; 1 = Lower
488	1 Bit	I	C - W - - -	DPT_Step	0/1	[CH] Auto: Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - - -	DPT_Trigger	0/1	[CH] Auto: Stop	0 = Stop; 1 = Stop
489	1 Byte	I	C - W - - -	DPT_Scaling	0% - 100%	[CH] Auto: Shutter Positioning	0% = Top; 100% = Bottom
490	1 Byte	I	C - W - - -	DPT_Scaling	0% - 100%	[CH] Auto: Slats Positioning	0% = Open; 100% = Closed
491	1 Bit	I	C - W T U	DPT_Scene_AB	0/1	[CH] Sunshine/Shadow	0 = Sunshine; 1 = Shadow
	1 Bit	I	C - W T U	DPT_Scene_AB	0/1	[CH] Sunshine/Shadow	0 = Shadow; 1 = Sunshine
492	1 Bit	I	C - W T U	DPT_Heat_Cool	0/1	[CH] Cooling/Heating	0 = Heating; 1 = Cooling
	1 Bit	I	C - W T U	DPT_Heat_Cool	0/1	[CH] Cooling/Heating	0 = Cooling; 1 = Heating
493	1 Bit	I	C - W T U	DPT_Occupancy	0/1	[CH] Presence/No Presence	0 = Presence; 1 = No Presence
	1 Bit	I	C - W T U	DPT_Occupancy	0/1	[CH] Presence/No Presence	0 = No Presence; 1 = Presence
494, 495	1 Bit	I	C - W - - -	DPT_Alarm	0/1	[CH] Alarm x	0 = No Alarm; 1 = Alarm
	1 Bit	I	C - W - - -	DPT_Alarm	0/1	[CH] Alarm x	0 = Alarm; 1 = No Alarm
496	1 Bit	I	C - W - - -	DPT_Ack	0/1	[CH] Unfreeze Alarm	Alarm1 = Alarm2 = No Alarm + Unfreeze (1) => End Alarm
497	1 Bit	I	C - W - - -	DPT_Scene_AB	0/1	[CH] Move (Reversed)	0 = Lower; 1 = Raise
498	1 Bit	I	C - W - - -	DPT_Ack	0/1	[CH] Direct Positioning 1	0 = No Action; 1 = Go to Position
499	1 Bit	I	C - W - - -	DPT_Ack	0/1	[CH] Direct Positioning 2	0 = No Action; 1 = Go to Position
500	1 Bit	I	C - W - - -	DPT_Ack	0/1	[CH] Direct Positioning 1 (Save)	0 = No Action; 1 = Save Current Position
501	1 Bit	I	C - W - - -	DPT_Ack	0/1	[CH] Direct Positioning 2 (Save)	0 = No Action; 1 = Save Current Position
502	1 Bit	I	C - W - - -	DPT_UpDown	0/1	[CI] Move	0 = Raise; 1 = Lower

503	1 Bit	I	C - W - -	DPT_Step	0/1	[CI] Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CI] Stop	0 = Stop; 1 = Stop
504	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CI] Switched Control	0, 1 = Up, Down or Stop, Depending on the Last Move
505	1 Bit	I	C - W - -	DPT_Enable	0/1	[CI] Lock	0 = Unlock; 1 = Lock
506	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CI] Shutter Positioning	0% = Top; 100% = Bottom
507	1 Byte	O	CR - T -	DPT_Scaling	0% - 100%	[CI] Shutter Position (Status)	0% = Top; 100% = Bottom
508	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CI] Slats Positioning	0% = Open; 100% = Closed
509	1 Byte	O	CR - T -	DPT_Scaling	0% - 100%	[CI] Slats Position (Status)	0% = Open; 100% = Closed
510	1 Bit	O	CR - T -	DPT_Switch	0/1	[CI] Raising Relay (Status)	0 = Open; 1 = Closed
511	1 Bit	O	CR - T -	DPT_Switch	0/1	[CI] Lowering Relay (Status)	0 = Open; 1 = Closed
512	1 Bit	O	CR - T -	DPT_Switch	0/1	[CI] Movement (Status)	0 = Stopped; 1 = Moving
513	1 Bit	O	CR - T -	DPT_UpDown	0/1	[CI] Movement Direction (Status)	0 = Upward; 1 = Downward
514	1 Bit	I	C - W - -	DPT_Switch	0/1	[CI] Auto: On/Off	0 = On; 1 = Off
	1 Bit	I	C - W - -	DPT_Switch	0/1	[CI] Auto: On/Off	0 = Off; 1 = On
515	1 Bit	O	CR - T -	DPT_Switch	0/1	[CI] Auto: On/Off (Status)	0 = On; 1 = Off
	1 Bit	O	CR - T -	DPT_Switch	0/1	[CI] Auto: On/Off (Status)	0 = Off; 1 = On
516	1 Bit	I	C - W - -	DPT_UpDown	0/1	[CI] Auto: Move	0 = Raise; 1 = Lower
517	1 Bit	I	C - W - -	DPT_Step	0/1	[CI] Auto: Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CI] Auto: Stop	0 = Stop; 1 = Stop
518	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CI] Auto: Shutter Positioning	0% = Top; 100% = Bottom
519	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CI] Auto: Slats Positioning	0% = Open; 100% = Closed
520	1 Bit	I	C - W T U	DPT_Scene_AB	0/1	[CI] Sunshine/Shadow	0 = Sunshine; 1 = Shadow
	1 Bit	I	C - W T U	DPT_Scene_AB	0/1	[CI] Sunshine/Shadow	0 = Shadow; 1 = Sunshine
521	1 Bit	I	C - W T U	DPT_Heat_Cool	0/1	[CI] Cooling/Heating	0 = Heating; 1 = Cooling
	1 Bit	I	C - W T U	DPT_Heat_Cool	0/1	[CI] Cooling/Heating	0 = Cooling; 1 = Heating
522	1 Bit	I	C - W T U	DPT_Occupancy	0/1	[CI] Presence/No Presence	0 = Presence; 1 = No Presence
	1 Bit	I	C - W T U	DPT_Occupancy	0/1	[CI] Presence/No Presence	0 = No Presence; 1 = Presence
523, 524	1 Bit	I	C - W - -	DPT_Alarm	0/1	[CI] Alarm x	0 = No Alarm; 1 = Alarm
	1 Bit	I	C - W - -	DPT_Alarm	0/1	[CI] Alarm x	0 = Alarm; 1 = No Alarm
525	1 Bit	I	C - W - -	DPT_Ack	0/1	[CI] Unfreeze Alarm	Alarm1 = Alarm2 = No Alarm + Unfreeze (1) => End Alarm
526	1 Bit	I	C - W - -	DPT_Scene_AB	0/1	[CI] Move (Reversed)	0 = Lower; 1 = Raise
527	1 Bit	I	C - W - -	DPT_Ack	0/1	[CI] Direct Positioning 1	0 = No Action; 1 = Go to Position

528	1 Bit	I	C - W - -	DPT_Ack	0/1	[CI] Direct Positioning 2	0 = No Action; 1 = Go to Position
529	1 Bit	I	C - W - -	DPT_Ack	0/1	[CI] Direct Positioning 1 (Save)	0 = No Action; 1 = Save Current Position
530	1 Bit	I	C - W - -	DPT_Ack	0/1	[CI] Direct Positioning 2 (Save)	0 = No Action; 1 = Save Current Position
531	1 Bit	I	C - W - -	DPT_UpDown	0/1	[CJ] Move	0 = Raise; 1 = Lower
532	1 Bit	I	C - W - -	DPT_Step	0/1	[CJ] Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CJ] Stop	0 = Stop; 1 = Stop
533	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CJ] Switched Control	0, 1 = Up, Down or Stop, Depending on the Last Move
534	1 Bit	I	C - W - -	DPT_Enable	0/1	[CJ] Lock	0 = Unlock; 1 = Lock
535	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CJ] Shutter Positioning	0% = Top; 100% = Bottom
536	1 Byte	O	C R - T -	DPT_Scaling	0% - 100%	[CJ] Shutter Position (Status)	0% = Top; 100% = Bottom
537	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CJ] Slats Positioning	0% = Open; 100% = Closed
538	1 Byte	O	C R - T -	DPT_Scaling	0% - 100%	[CJ] Slats Position (Status)	0% = Open; 100% = Closed
539	1 Bit	O	C R - T -	DPT_Switch	0/1	[CJ] Rising Relay (Status)	0 = Open; 1 = Closed
540	1 Bit	O	C R - T -	DPT_Switch	0/1	[CJ] Lowering Relay (Status)	0 = Open; 1 = Closed
541	1 Bit	O	C R - T -	DPT_Switch	0/1	[CJ] Movement (Status)	0 = Stopped; 1 = Moving
542	1 Bit	O	C R - T -	DPT_UpDown	0/1	[CJ] Movement Direction (Status)	0 = Upward; 1 = Downward
543	1 Bit	I	C - W - -	DPT_Switch	0/1	[CJ] Auto: On/Off	0 = On; 1 = Off
	1 Bit	I	C - W - -	DPT_Switch	0/1	[CJ] Auto: On/Off	0 = Off; 1 = On
544	1 Bit	O	C R - T -	DPT_Switch	0/1	[CJ] Auto: On/Off (Status)	0 = On; 1 = Off
	1 Bit	O	C R - T -	DPT_Switch	0/1	[CJ] Auto: On/Off (Status)	0 = Off; 1 = On
545	1 Bit	I	C - W - -	DPT_UpDown	0/1	[CJ] Auto: Move	0 = Raise; 1 = Lower
546	1 Bit	I	C - W - -	DPT_Step	0/1	[CJ] Auto: Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CJ] Auto: Stop	0 = Stop; 1 = Stop
547	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CJ] Auto: Shutter Positioning	0% = Top; 100% = Bottom
548	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CJ] Auto: Slats Positioning	0% = Open; 100% = Closed
549	1 Bit	I	C - W T U	DPT_Scene_AB	0/1	[CJ] Sunshine/Shadow	0 = Sunshine; 1 = Shadow
	1 Bit	I	C - W T U	DPT_Scene_AB	0/1	[CJ] Sunshine/Shadow	0 = Shadow; 1 = Sunshine
550	1 Bit	I	C - W T U	DPT_Heat_Cool	0/1	[CJ] Cooling/Heating	0 = Heating; 1 = Cooling
	1 Bit	I	C - W T U	DPT_Heat_Cool	0/1	[CJ] Cooling/Heating	0 = Cooling; 1 = Heating
551	1 Bit	I	C - W T U	DPT_Occupancy	0/1	[CJ] Presence/No Presence	0 = Presence; 1 = No Presence
	1 Bit	I	C - W T U	DPT_Occupancy	0/1	[CJ] Presence/No Presence	0 = No Presence; 1 = Presence
552, 553	1 Bit	I	C - W - -	DPT_Alarm	0/1	[CJ] Alarm x	0 = No Alarm; 1 = Alarm

	1 Bit	I	C - W - -	DPT_Alarm	0/1	[CJ] Alarm x	0 = Alarm; 1 = No Alarm
554	1 Bit	I	C - W - -	DPT_Ack	0/1	[CJ] Unfreeze Alarm	Alarm1 = Alarm2 = No Alarm + Unfreeze (1) => End Alarm
555	1 Bit	I	C - W - -	DPT_Scene_AB	0/1	[CJ] Move (Reversed)	0 = Lower; 1 = Raise
556	1 Bit	I	C - W - -	DPT_Ack	0/1	[CJ] Direct Positioning 1	0 = No Action; 1 = Go to Position
557	1 Bit	I	C - W - -	DPT_Ack	0/1	[CJ] Direct Positioning 2	0 = No Action; 1 = Go to Position
558	1 Bit	I	C - W - -	DPT_Ack	0/1	[CJ] Direct Positioning 1 (Save)	0 = No Action; 1 = Save Current Position
559	1 Bit	I	C - W - -	DPT_Ack	0/1	[CJ] Direct Positioning 2 (Save)	0 = No Action; 1 = Save Current Position
560	1 Bit	I	C - W - -	DPT_UpDown	0/1	[CK] Move	0 = Raise; 1 = Lower
561	1 Bit	I	C - W - -	DPT_Step	0/1	[CK] Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CK] Stop	0 = Stop; 1 = Stop
562	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CK] Switched Control	0, 1 = Up, Down or Stop, Depending on the Last Move
563	1 Bit	I	C - W - -	DPT_Enable	0/1	[CK] Lock	0 = Unlock; 1 = Lock
564	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CK] Shutter Positioning	0% = Top; 100% = Bottom
565	1 Byte	O	CR - T -	DPT_Scaling	0% - 100%	[CK] Shutter Position (Status)	0% = Top; 100% = Bottom
566	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CK] Slats Positioning	0% = Open; 100% = Closed
567	1 Byte	O	CR - T -	DPT_Scaling	0% - 100%	[CK] Slats Position (Status)	0% = Open; 100% = Closed
568	1 Bit	O	CR - T -	DPT_Switch	0/1	[CK] Rising Relay (Status)	0 = Open; 1 = Closed
569	1 Bit	O	CR - T -	DPT_Switch	0/1	[CK] Lowering Relay (Status)	0 = Open; 1 = Closed
570	1 Bit	O	CR - T -	DPT_Switch	0/1	[CK] Movement (Status)	0 = Stopped; 1 = Moving
571	1 Bit	O	CR - T -	DPT_UpDown	0/1	[CK] Movement Direction (Status)	0 = Upward; 1 = Downward
572	1 Bit	I	C - W - -	DPT_Switch	0/1	[CK] Auto: On/Off	0 = On; 1 = Off
	1 Bit	I	C - W - -	DPT_Switch	0/1	[CK] Auto: On/Off	0 = Off; 1 = On
573	1 Bit	O	CR - T -	DPT_Switch	0/1	[CK] Auto: On/Off (Status)	0 = On; 1 = Off
	1 Bit	O	CR - T -	DPT_Switch	0/1	[CK] Auto: On/Off (Status)	0 = Off; 1 = On
574	1 Bit	I	C - W - -	DPT_UpDown	0/1	[CK] Auto: Move	0 = Raise; 1 = Lower
575	1 Bit	I	C - W - -	DPT_Step	0/1	[CK] Auto: Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CK] Auto: Stop	0 = Stop; 1 = Stop
576	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CK] Auto: Shutter Positioning	0% = Top; 100% = Bottom
577	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CK] Auto: Slats Positioning	0% = Open; 100% = Closed
578	1 Bit	I	C - W T U	DPT_Scene_AB	0/1	[CK] Sunshine/Shadow	0 = Sunshine; 1 = Shadow

	1 Bit	I	C - W T U	DPT_Scene_AB	0/1	[CK] Sunshine/Shadow	0 = Shadow; 1 = Sunshine
579	1 Bit	I	C - W T U	DPT_Heat_Cool	0/1	[CK] Cooling/Heating	0 = Heating; 1 = Cooling
	1 Bit	I	C - W T U	DPT_Heat_Cool	0/1	[CK] Cooling/Heating	0 = Cooling; 1 = Heating
580	1 Bit	I	C - W T U	DPT_Occupancy	0/1	[CK] Presence/No Presence	0 = Presence; 1 = No Presence
	1 Bit	I	C - W T U	DPT_Occupancy	0/1	[CK] Presence/No Presence	0 = No Presence; 1 = Presence
581, 582	1 Bit	I	C - W - -	DPT_Alarm	0/1	[CK] Alarm x	0 = No Alarm; 1 = Alarm
	1 Bit	I	C - W - -	DPT_Alarm	0/1	[CK] Alarm x	0 = Alarm; 1 = No Alarm
583	1 Bit	I	C - W - -	DPT_Ack	0/1	[CK] Unfreeze Alarm	Alarm1 = Alarm2 = No Alarm + Unfreeze (1) => End Alarm
584	1 Bit	I	C - W - -	DPT_Scene_AB	0/1	[CK] Move (Reversed)	0 = Lower; 1 = Raise
585	1 Bit	I	C - W - -	DPT_Ack	0/1	[CK] Direct Positioning 1	0 = No Action; 1 = Go to Position
586	1 Bit	I	C - W - -	DPT_Ack	0/1	[CK] Direct Positioning 2	0 = No Action; 1 = Go to Position
587	1 Bit	I	C - W - -	DPT_Ack	0/1	[CK] Direct Positioning 1 (Save)	0 = No Action; 1 = Save Current Position
588	1 Bit	I	C - W - -	DPT_Ack	0/1	[CK] Direct Positioning 2 (Save)	0 = No Action; 1 = Save Current Position
589	1 Bit	I	C - W - -	DPT_UpDown	0/1	[CL] Move	0 = Raise; 1 = Lower
590	1 Bit	I	C - W - -	DPT_Step	0/1	[CL] Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CL] Stop	0 = Stop; 1 = Stop
591	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CL] Switched Control	0, 1 = Up, Down or Stop, Depending on the Last Move
592	1 Bit	I	C - W - -	DPT_Enable	0/1	[CL] Lock	0 = Unlock; 1 = Lock
593	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CL] Shutter Positioning	0% = Top; 100% = Bottom
594	1 Byte	O	C R - T -	DPT_Scaling	0% - 100%	[CL] Shutter Position (Status)	0% = Top; 100% = Bottom
595	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CL] Slats Positioning	0% = Open; 100% = Closed
596	1 Byte	O	C R - T -	DPT_Scaling	0% - 100%	[CL] Slats Position (Status)	0% = Open; 100% = Closed
597	1 Bit	O	C R - T -	DPT_Switch	0/1	[CL] Rising Relay (Status)	0 = Open; 1 = Closed
598	1 Bit	O	C R - T -	DPT_Switch	0/1	[CL] Lowering Relay (Status)	0 = Open; 1 = Closed
599	1 Bit	O	C R - T -	DPT_Switch	0/1	[CL] Movement (Status)	0 = Stopped; 1 = Moving
600	1 Bit	O	C R - T -	DPT_UpDown	0/1	[CL] Movement Direction (Status)	0 = Upward; 1 = Downward
601	1 Bit	I	C - W - -	DPT_Switch	0/1	[CL] Auto: On/Off	0 = On; 1 = Off
	1 Bit	I	C - W - -	DPT_Switch	0/1	[CL] Auto: On/Off	0 = Off; 1 = On
602	1 Bit	O	C R - T -	DPT_Switch	0/1	[CL] Auto: On/Off (Status)	0 = On; 1 = Off
	1 Bit	O	C R - T -	DPT_Switch	0/1	[CL] Auto: On/Off (Status)	0 = Off; 1 = On
603	1 Bit	I	C - W - -	DPT_UpDown	0/1	[CL] Auto: Move	0 = Raise; 1 = Lower

604	1 Bit	I	C - W - -	DPT_Step	0/1	[CL] Auto: Stop/Step	0 = Stop/StepUp; 1 = Stop/StepDown
	1 Bit	I	C - W - -	DPT_Trigger	0/1	[CL] Auto: Stop	0 = Stop; 1 = Stop
605	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CL] Auto: Shutter Positioning	0% = Top; 100% = Bottom
606	1 Byte	I	C - W - -	DPT_Scaling	0% - 100%	[CL] Auto: Slats Positioning	0% = Open; 100% = Closed
607	1 Bit	I	C - W T U	DPT_Scene_AB	0/1	[CL] Sunshine/Shadow	0 = Sunshine; 1 = Shadow
	1 Bit	I	C - W T U	DPT_Scene_AB	0/1	[CL] Sunshine/Shadow	0 = Shadow; 1 = Sunshine
608	1 Bit	I	C - W T U	DPT_Heat_Cool	0/1	[CL] Cooling/Heating	0 = Heating; 1 = Cooling
	1 Bit	I	C - W T U	DPT_Heat_Cool	0/1	[CL] Cooling/Heating	0 = Cooling; 1 = Heating
609	1 Bit	I	C - W T U	DPT_Occupancy	0/1	[CL] Presence/No Presence	0 = Presence; 1 = No Presence
	1 Bit	I	C - W T U	DPT_Occupancy	0/1	[CL] Presence/No Presence	0 = No Presence; 1 = Presence
610, 611	1 Bit	I	C - W - -	DPT_Alarm	0/1	[CL] Alarm x	0 = No Alarm; 1 = Alarm
	1 Bit	I	C - W - -	DPT_Alarm	0/1	[CL] Alarm x	0 = Alarm; 1 = No Alarm
612	1 Bit	I	C - W - -	DPT_Ack	0/1	[CL] Unfreeze Alarm	Alarm1 = Alarm2 = No Alarm + Unfreeze (1) => End Alarm
613	1 Bit	I	C - W - -	DPT_Scene_AB	0/1	[CL] Move (Reversed)	0 = Lower; 1 = Raise
614	1 Bit	I	C - W - -	DPT_Ack	0/1	[CL] Direct Positioning 1	0 = No Action; 1 = Go to Position
615	1 Bit	I	C - W - -	DPT_Ack	0/1	[CL] Direct Positioning 2	0 = No Action; 1 = Go to Position
616	1 Bit	I	C - W - -	DPT_Ack	0/1	[CL] Direct Positioning 1 (Save)	0 = No Action; 1 = Save Current Position
617	1 Bit	I	C - W - -	DPT_Ack	0/1	[CL] Direct Positioning 2 (Save)	0 = No Action; 1 = Save Current Position
618	1 Byte	I	C - W - U	DPT_SceneControl	0-63; 128-191	[Fan Coil] Scenes	0 - 63 (Execute 1 - 64); 128 - 191 (Save 1 - 64)
619, 652, 685, 718, 751, 784	1 Bit	I	C - W - U	DPT_Switch	0/1	[FCx] On/Off	0 = Off; 1 = On
620, 653, 686, 719, 752, 785	1 Bit	O	C R - T -	DPT_Switch	0/1	[FCx] On/Off (Status)	0 = Off; 1 = On
621, 654, 687, 720, 753, 786	1 Bit	I	C - W - U	DPT_Heat_Cool	0/1	[FCx] Mode	0 = Cool; 1 = Heat
622, 655, 688, 721, 754, 787	1 Bit	O	C R - T -	DPT_Heat_Cool	0/1	[FCx] Mode (Status)	0 = Cool; 1 = Heat
623, 656, 689, 722, 755, 788	1 Bit	I	C - W - U	DPT_Enable	0/1	[FCx] Fan: Manual/Automatic	0 = Automatic; 1 = Manual
	1 Bit	I	C - W - U	DPT_Enable	0/1	[FCx] Fan: Manual/Automatic	0 = Manual; 1 = Automatic
624, 657, 690, 723, 756, 789	1 Bit	O	C R - T -	DPT_Enable	0/1	[FCx] Fan: Manual/Automatic (Status)	0 = Automatic; 1 = Manual
	1 Bit	O	C R - T -	DPT_Enable	0/1	[FCx] Fan: Manual/Automatic (Status)	0 = Manual; 1 = Automatic
625, 658, 691, 724, 757, 790	1 Bit	I	C - W - U	DPT_Step	0/1	[FCx] Manual Fan: Step Control	0 = Down; 1 = Up
626, 659, 692, 725, 758, 791	1 Bit	I	C - W - U	DPT_Switch	0/1	[FCx] Manual Fan: Speed 0	0 = Off; 1 = On
627, 660, 693, 726, 759, 792	1 Bit	I	C - W - U	DPT_Switch	0/1	[FCx] Manual Fan: Speed 1	0 = Off; 1 = On

628, 661, 694, 727, 760, 793	1 Bit	I	C - W - U	DPT_Switch	0/1	[FCx] Manual Fan: Speed 2	0 = Off; 1 = On
629, 662, 695, 728, 761, 794	1 Bit	I	C - W - U	DPT_Switch	0/1	[FCx] Manual Fan: Speed 3	0 = Off; 1 = On
630, 663, 696, 729, 762, 795	1 Bit	O	CR - T -	DPT_Switch	0/1	[FCx] Fan: Speed 0 (Status)	0 = Off; 1 = On
631, 664, 697, 730, 763, 796	1 Bit	O	CR - T -	DPT_Switch	0/1	[FCx] Fan: Speed 1 (Status)	0 = Off; 1 = On
632, 665, 698, 731, 764, 797	1 Bit	O	CR - T -	DPT_Switch	0/1	[FCx] Fan: Speed 2 (Status)	0 = Off; 1 = On
633, 666, 699, 732, 765, 798	1 Bit	O	CR - T -	DPT_Switch	0/1	[FCx] Fan: Speed 3 (Status)	0 = Off; 1 = On
634, 667, 700, 733, 766, 799	1 Byte	I	C - W - U	DPT_Fan_Stage	0 - 255	[FCx] Manual Fan: Enumeration Control	S0 = 0; S1 = 1; S2 = 2; S3 = 3
	1 Byte	I	C - W - U	DPT_Fan_Stage	0 - 255	[FCx] Manual Fan: Enumeration Control	S0 = 0; S1 = 1; S2 = 2
	1 Byte	I	C - W - U	DPT_Fan_Stage	0 - 255	[FCx] Manual Fan: Enumeration Control	S0 = 0; S1 = 1
635, 668, 701, 734, 767, 800	1 Byte	O	CR - T -	DPT_Fan_Stage	0 - 255	[FCx] Fan: Speed Enumeration (Status)	S0 = 0; S1 = 1; S2 = 2; S3 = 3
	1 Byte	O	CR - T -	DPT_Fan_Stage	0 - 255	[FCx] Fan: Speed Enumeration (Status)	S0 = 0; S1 = 1; S2 = 2
	1 Byte	O	CR - T -	DPT_Fan_Stage	0 - 255	[FCx] Fan: Speed Enumeration (Status)	S0 = 0; S1 = 1
636, 669, 702, 735, 768, 801	1 Byte	I	C - W - U	DPT_Scaling	0% - 100%	[FCx] Manual Fan: Percentage Control	S0 = 0%; S1 = 0,4-33,3%; S2 = 33,7-66,7%; S3 = 67,1-100%
	1 Byte	I	C - W - U	DPT_Scaling	0% - 100%	[FCx] Manual Fan: Percentage Control	S0 = 0%; S1 = 1-50%; S2 = 51-100%
	1 Byte	I	C - W - U	DPT_Scaling	0% - 100%	[FCx] Manual Fan: Percentage Control	S0 = 0%; S1 = 1-100%
637, 670, 703, 736, 769, 802	1 Byte	O	CR - T -	DPT_Scaling	0% - 100%	[FCx] Fan: Speed Percentage (Status)	S0 = 0%; S1 = 33,3%; S2 = 66,6%; S3 = 100%
	1 Byte	O	CR - T -	DPT_Scaling	0% - 100%	[FCx] Fan: Speed Percentage (Status)	S0 = 0%; S1 = 1-50%; S2 = 51-100%
	1 Byte	O	CR - T -	DPT_Scaling	0% - 100%	[FCx] Fan: Speed Percentage (Status)	S0 = 0%; S1 = 1-100%
638, 671, 704, 737, 770, 803	1 Byte	I	C - W - U	DPT_Scaling	0% - 100%	[FCx] Cooling Fan: Continuous Control	0 - 100%
	1 Byte	I	C - W - U	DPT_Scaling	0% - 100%	[FCx] Cooling Valve: PI Control (Continuous)	0 - 100%
639, 672, 705, 738, 771, 804	1 Byte	I	C - W - U	DPT_Scaling	0% - 100%	[FCx] Heating Fan: Continuous Control	0 - 100%
	1 Byte	I	C - W - U	DPT_Scaling	0% - 100%	[FCx] Heating Valve: PI Control (Continuous)	0 - 100%
640, 673, 706, 739, 772, 805	1 Bit	I	C - W - U	DPT_OpenClose	0/1	[FCx] Cooling Valve: Control Variable (1 bit)	0 = Open Valve; 1 = Close Valve

	1 Bit	I	C - W - U	DPT_Switch	0/1	[FCx] Cooling Valve: Control Variable (1 bit)	0 = Close Valve; 1 = Open Valve
641, 674, 707, 740, 773, 806	1 Bit	I	C - W - U	DPT_OpenClose	0/1	[FCx] Heating Valve: Control Variable (1 bit)	0 = Open Valve; 1 = Close Valve
	1 Bit	I	C - W - U	DPT_Switch	0/1	[FCx] Heating Valve: Control Variable (1 bit)	0 = Close Valve; 1 = Open Valve
642, 675, 708, 741, 774, 807	1 Bit	O	CR - T -	DPT_OpenClose	0/1	[FCx] Cooling Valve (Status)	0 = Open; 1 = Closed
	1 Bit	O	CR - T -	DPT_Switch	0/1	[FCx] Cooling Valve (Status)	0 = Closed; 1 = Open
	1 Bit	O	CR - T -	DPT_OpenClose	0/1	[FCx] Valve (Status)	0 = Open; 1 = Closed
	1 Bit	O	CR - T -	DPT_Switch	0/1	[FCx] Valve (Status)	0 = Closed; 1 = Open
643, 676, 709, 742, 775, 808	1 Bit	O	CR - T -	DPT_OpenClose	0/1	[FCx] Heating Valve (Status)	0 = Open; 1 = Closed
	1 Bit	O	CR - T -	DPT_Switch	0/1	[FCx] Heating Valve (Status)	0 = Closed; 1 = Open
644, 677, 710, 743, 776, 809	1 Bit	O	CR - T -	DPT_Switch	0/1	[FCx] Cooling Valve: Anti-Seize Protection (Status)	0 = Not Active; 1 = Active
	1 Bit	O	CR - T -	DPT_Switch	0/1	[FCx] Valve: Anti-Seize Protection (Status)	0 = Not Active; 1 = Active
645, 678, 711, 744, 777, 810	1 Bit	O	CR - T -	DPT_Switch	0/1	[FCx] Heating Valve: Anti-Seize Protection (Status)	0 = Not Active; 1 = Active
	1 Byte	O	CR - T -	DPT_Scaling	0% - 100%	[FCx] Valve (Status)	0 - 100%
646, 679, 712, 745, 778, 811	1 Byte	O	CR - T -	DPT_Scaling	0% - 100%	[FCx] Cooling Valve (Status)	0 - 100%
	1 Byte	O	CR - T -	DPT_Scaling	0% - 100%	[FCx] Heating Valve (Status)	0 - 100%
647, 680, 713, 746, 779, 812	1 Byte	O	CR - T -	DPT_Scaling	0% - 100%	[FCx] Heating Valve (Status)	0 - 100%
648, 681, 714, 747, 780, 813	1 Bit	O	CR - T -	DPT_Bool	0/1	[FCx] Control Value - Error	0 = No Error; 1 = Error
649, 682, 715, 748, 781, 814	2 Bytes	I	C - W - U	DPT_Value_Temp	-273.00° - 670433.28°	[FCx] Ambient Temperature	Ambient Temperature
650, 683, 716, 749, 782, 815	2 Bytes	I	C - W - U	DPT_Value_Temp	-273.00° - 670433.28°	[FCx] Setpoint Temperature	Setpoint Temperature
651, 684, 717, 750, 783, 816	2 Bytes	I/O	CRWTU	DPT_TimePeriodMin	0 - 65535	[FCx] Duration of Manual Control	0 = Endless; 1 - 1440 min
	2 Bytes	I/O	CRWTU	DPT_TimePeriodHrs	0 - 65535	[FCx] Duration of Manual Control	0 = Endless; 1 - 24 h
817, 818, 819, 820, 821, 822, 823, 824, 825, 826, 827, 828, 829, 830, 831, 832, 833, 834, 835, 836, 837, 838, 839, 840, 841, 842, 843, 844, 845, 846, 847, 848, 849, 850, 851, 852, 853, 854, 855, 856, 857, 858, 859, 860, 861, 862, 863, 864, 865, 866, 867, 868, 869, 870, 871, 872, 873, 874, 875, 876, 877, 878, 879, 880	1 Bit	I	C - W - -	DPT_Bool	0/1	[LF] (1-Bit) Data Entry x	Binary Data Entry (0/1)
881, 882, 883, 884, 885, 886, 887, 888, 889, 890, 891, 892, 893, 894, 895, 896, 897, 898, 899, 900, 901, 902, 903, 904,	1 Byte	I	C - W - -	DPT_Value_1_Ucount	0 - 255	[LF] (1-Byte) Data Entry x	1-Byte Data Entry (0-255)

905, 906, 907, 908, 909, 910, 911, 912							
913, 914, 915, 916, 917, 918, 919, 920, 921, 922, 923, 924, 925, 926, 927, 928, 929, 930, 931, 932, 933, 934, 935, 936, 937, 938, 939, 940, 941, 942, 943, 944	2 Bytes	I	C - W - -	DPT_Value_2_Ucount	0 - 65535	[LF] (2-Byte) Data Entry x	2-Byte Data Entry
945, 946, 947, 948, 949, 950, 951, 952, 953, 954, 955, 956, 957, 958, 959, 960	4 Bytes	I	C - W - -	DPT_Value_4_Count	-2147483648 - 2147483647	[LF] (4-Byte) Data Entry x	4-Byte Data Entry
961, 962, 963, 964, 965, 966, 967, 968, 969, 970, 971, 972, 973, 974, 975, 976, 977, 978, 979, 980, 981, 982, 983, 984, 985, 986, 987, 988, 989, 990	1 Bit	O	C R - T -	DPT_Bool	0/1	[LF] Function x - Result	(1-Bit) Boolean
	1 Byte	O	C R - T -	DPT_Value_1_Ucount	0 - 255	[LF] Function x - Result	(1-Byte) Unsigned
	2 Bytes	O	C R - T -	DPT_Value_2_Ucount	0 - 65535	[LF] Function x - Result	(2-Byte) Unsigned
	4 Bytes	O	C R - T -	DPT_Value_4_Count	-2147483648 - 2147483647	[LF] Function x - Result	(4-Byte) Signed
	1 Byte	O	C R - T -	DPT_Scaling	0% - 100%	[LF] Function x - Result	(1-Byte) Percentage
	2 Bytes	O	C R - T -	DPT_Value_2_Count	-32768 - 32767	[LF] Function x - Result	(2-Byte) Signed
	2 Bytes	O	C R - T -	9.xxx	-671088.64 - 670433.28	[LF] Function x - Result	(2-Byte) Float
991, 993, 995, 997, 999, 1001, 1003, 1005, 1007, 1009, 1011, 1013, 1015, 1017, 1019, 1021, 1023, 1025, 1027, 1029, 1031, 1033, 1035, 1037	4 Bytes	O	C R - T -	DPT_Value_4_Ucount	0 - 4294967295	[Relay x] Number of Switches	Number of Switches
992, 994, 996, 998, 1000, 1002, 1004, 1006, 1008, 1010, 1012, 1014, 1016, 1018, 1020, 1022, 1024, 1026, 1028, 1030, 1032, 1034, 1036, 1038	2 Bytes	O	C R - T -	DPT_Value_2_Ucount	0 - 65535	[Relay x] Maximum Switches per Minute	Maximum Switches per Minute
1039, 1061	1 Bit	I	C - W - -	DPT_Switch	0/1	[MLx] Trigger	Trigger the Master Light Function
1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073	1 Bit	I	C - W - -	DPT_Switch	0/1	[MLx] Status Object x	Binary Status
1052, 1074	1 Bit	O	C R - T -	DPT_Switch	0/1	[MLx] General Status	Binary Status
1053, 1075	1 Bit		C - - T -	DPT_Switch	0/1	[MLx] General Switch Off: Binary Object	Switch Off Sending
1054, 1076	1 Byte		C - - T -	DPT_Scaling	0% - 100%	[MLx] General Switch Off: Scaling	0-100%

1055, 1077	1 Byte		C - - T -	DPT_SceneControl	0-63; 128-191	[MLx] General Switch Off: Scene	Scene Sending
1056, 1078	1 Byte		C - - T -	DPT_HVACMode	1=Comfort 2=Standby 3=Economy 4=Building Protection	[MLx] General Switch Off: HVAC mode	Auto, Comfort, Standby, Economy, Building Protection
1057, 1079	1 Bit		C - - T -	DPT_Switch	0/1	[MLx] Courtesy Switch On: Binary Object	Switch On Sending
1058, 1080	1 Byte		C - - T -	DPT_Scaling	0% - 100%	[MLx] Courtesy Switch On: Scaling	0-100%
1059, 1081	1 Byte		C - - T -	DPT_SceneControl	0-63; 128-191	[MLx] Courtesy Switch On: Scene	Scene Sending
1060, 1082	1 Byte		C - - T -	DPT_HVACMode	1=Comfort 2=Standby 3=Economy 4=Building Protection	[MLx] Courtesy Switch On: HVAC mode	Auto, Comfort, Standby, Economy, Building Protection

Join and send us your inquiries
about Zennio devices:

<https://support.zennio.com>

Zennio Avance y Tecnología S.L.

C/ Río Jarama, 132. Nave P-8.11
45007 Toledo (Spain).

Tel. +34 925 232 002

www.zennio.com

info@zennio.com